Wildfire Mitigation Plan Action Statement: Trans Bay Cable

Wildfire Safety Division

Draft Action Statement on Trans Bay Cable's 2021 Wildfire Mitigation Plan Update

June 2021

# Contents

Introduction and Background1				
1. Sun	nmary of key findings	4		
1.1.	Areas of Significant Progress	4		
1.2.	Revision Notices	4		
1.3.	Key Areas for Improvement and Remedies	4		
1.4.	Maturity Model Evaluation	5		
2. Wile	dfire Safety Advisory Board Input	5		
3. Pub	plic and Stakeholder Comment	6		
4. Disc	cussion			
4.1.	Introductory sections of the WMP	6		
4.2.	Actuals and planned spending for Mitigation Plan			
4.3.	Lessons learned and risk trends			
4.4.	Inputs to the plan and directional vision for WMP			
4.5.	Metrics and underlying data	9		
5. Mit	tigation initiatives and maturity evaluation			
5.1.	Risk Assessment and Mapping			
5.2.	Situational Awareness and Forecasting	13		
5.3.	Grid Design and System Hardening			
5.4.	Asset Management and Inspections			
5.5.	Vegetation Management and Inspections			
5.6.	Grid Operations and Operating Protocols, including PSPS	19		
5.7.	Data Governance			
5.8.	Resource Allocation Methodology			
5.9.	Emergency Planning and Preparedness			
5.10.	1 7 8 8			
	blic Safety Power Shutoff (PSPS), including directional vision for PSPS			
	xt steps			
	nsultation with CAL FIRE			
	nclusion			
	pendix			
-	Status of 2020 WMP Deficiencies			
	achments			
	Attachment 1: TBC's 2021 Maturity Survey			
	1.1. TBC: Description of Data Sources			
11.1	, 6			
	1.3. TBC: Maturity detail by capability			
11.1	1.4. TBC: Numerical maturity summary	59		

# INTRODUCTION AND BACKGROUND

This Action Statement represents the assessment of the California Public Utilities Commission's (CPUC) Wildfire Safety Division (WSD)<sup>1</sup> on the 2021 Wildfire Mitigation Plan (WMP or Plan) of Trans Bay Cable (TBC or the utility). This Plan is an update for the comprehensive 2020-2022 plan filed by TBC in 2020. TBC submitted its 2021 WMP Update on March 5, 2021 in response to guidelines provided by the WSD.<sup>2</sup> Assembly Bill 1054<sup>3</sup> mandates that the WSD complete its evaluation of WMPs within three months of submission, unless the WSD issues an extension.<sup>4</sup>

TBC's 2021 WMP Update is approved.

1. Legal Authority

In 2018, following the devastating wildfires in 2016 and 2017, the California Legislature passed several bills increasing oversight of the electrical corporations' efforts to reduce utility-related wildfires.<sup>5</sup> AB 1054 created the WSD at the CPUC and tasked it with reviewing annual WMPs submitted by electrical corporations under the CPUC's jurisdiction. As of July 2021, the WSD will become the Office of Energy Infrastructure Safety (Energy Safety) within the California Natural Resources Agency (CNRA).<sup>6</sup>

The main regulatory vehicle for the WSD to evaluate electrical corporations' wildfire risk reduction efforts is the WMP, which was first introduced in Senate Bill (SB) 1028<sup>7</sup> and further defined in SB 901,<sup>8</sup> AB 1054, and AB 111. Investor-owned electrical corporations (hereafter referred to as "utilities") are required to submit WMPs assessing their level of wildfire risk and providing plans for wildfire risk reduction. The CPUC evaluated the utilities' first WMPs under the SB 901 framework in 2019.<sup>9</sup>

AB 1054 and AB 111 transferred responsibility for evaluation and approval or denial of WMPs to the WSD; AB 1054 provides, "After approval by the division, the commission shall ratify the

<sup>&</sup>lt;sup>1</sup> Because the WSD is transitioning to the Office of Energy Infrastructure Safety (Energy Safety) on July 1, 2021, any references herein to WSD actions that post-date this transition should be interpreted as actions for which Energy Safety will take responsibility. Section 10 of the associated Resolution provides further detail on the transition of the WSD to Energy Safety.

<sup>&</sup>lt;sup>2</sup> The Commission approved 2021 WMP guidelines in Resolution WSD-011.

<sup>&</sup>lt;sup>3</sup> Stats. of 2019, Ch. 79.

<sup>&</sup>lt;sup>4</sup> Pub. Util. Code § 8386.3(a).

<sup>&</sup>lt;sup>5</sup> In this document "utility" should be understood to mean "electrical corporation."

<sup>&</sup>lt;sup>6</sup> See AB 111, Stats. of 2019, Ch. 81.

<sup>&</sup>lt;sup>7</sup> Stats. of 2016, Ch. 598.

<sup>&</sup>lt;sup>8</sup> Stats. of 2018, Ch. 626.

<sup>&</sup>lt;sup>9</sup> See Rulemaking (R.) 18-10-007.

action of the division."<sup>10</sup> The WSD must ensure utility wildfire mitigation efforts sufficiently address increasing utility wildfire risk. To support its efforts, the WSD developed a long-term strategic roadmap, Reducing Utility-Related Wildfire Risk (2020).<sup>11</sup> This strategic roadmap informs the WSD's work in updating the WMP process and guidelines and the WSD's evaluation of the WMPs.

## 2. Multi-Year Plan Process

In February and March of 2020, the utilities<sup>12</sup> submitted their three-year 2020-2022 WMPs. The WSD conducted its evaluation and either approved, conditionally approved, or denied the Plans. In the case of conditional approval, the WSD identified items missing or incomplete in the Plans on a scale of severity, with Class A Deficiencies representing issues that required resolution through a Remedial Compliance Plan (RCP).<sup>13</sup> The 2020 Class B Deficiencies required resolution through Quarterly Reports,<sup>14</sup> and Class C Deficiencies were to be resolved in the 2021 WMP Update.

The WSD approved TBC's 2020 WMP.

## 3. 2021 Evaluation Process

On November 16, 2020, the CPUC adopted updated WMP requirements (Guidelines) and procedures for the 2021 WMP Plan Year pursuant to Pub. Util. Code Section 8389(d).<sup>15</sup> The updates to the 2021 WMP Guidelines are intended to streamline the reporting and evaluation process. Pursuant to the adopted Guidelines, large utilities submitted 2021 WMP Updates on February 5, 2021; small and multi-jurisdictional utilities (SMJUs) and independent transmission operators (ITOs) submitted 2021 WMP Updates on March 5, 2021.

The 2021 WMP submissions are updates of the 2020-2022 WMPs and are intended to show progress since 2020 and report changes from the 2020 WMP. Importantly for 2021, the WSD amended its review process and will no longer issue conditional approvals. Instead, where the WSD found critical issues with 2021 submissions, the WSD is issuing a Revision Notice requiring

<sup>&</sup>lt;sup>10</sup> Pub. Util. Code § 8386.3(a).

<sup>&</sup>lt;sup>11</sup> The Wildfire Safety Division's strategic roadmap Reducing Utility-Related Wildfire Risk (2020) (accessed March 4, 2021): https://www.cpuc.ca.gov/WSD/roadmap/

<sup>&</sup>lt;sup>12</sup> Here we refer to all utilities that submitted a WMP in 2020: Pacific Gas and Electric Company (PG&E), Southern California Edison Company (SCE), San Diego Gas & Electric Company (SDG&E), PacifiCorp, Bear Valley Electric Service, Inc. (BVES), Liberty Utilities, Trans Bay Cable, LLC, and Horizon West Transmission, LLC; hereafter in this Action Statement "utilities" refers to the two ITOs, TBC and HWT, unless otherwise specified.

<sup>&</sup>lt;sup>13</sup> An RCP "must present all missing information and/or articulate the electrical corporation's plan, including proposed timeline, to bring the electrical corporation's WMP into compliance." See Resolution WSD-002 at 17.

<sup>&</sup>lt;sup>14</sup> "Class B issues are of moderate concern and require reporting on a quarterly basis by the electrical corporation to provide missing data or update its progress in a quarterly report." See Resolution WSD-002 at 18.

<sup>&</sup>lt;sup>15</sup> See <u>www.cpuc.ca.gov/wildfiremitigationplans</u> for adopted 2021 WMP Update Guidelines.

the utility to remedy such issues prior to completion of the 2021 WMP Update evaluation. Upon receipt of the utility's response to the Revision Notice, the WSD will determine whether the response is sufficient to warrant approval, although additional ongoing reporting or other conditions may be required, or the response is insufficient such that denial of the WMP is warranted due to the utility inadequately reducing wildfire risk and its potential impact to public safety.

The WSD evaluated 2021 WMP Updates according to the following factors:

- <u>Completeness:</u> The WMP is complete and comprehensively responds to the WMP statutory requirements and WMP Guidelines.
- <u>Technical feasibility and effectiveness</u>: Initiatives proposed in the WMP are technically feasible and are effective in addressing the risks that exist in the utility's service territory.
- <u>Resource use efficiency</u>: Initiatives are an efficient use of utility resources and focus on achieving the greatest risk reduction at the lowest cost.
- <u>Demonstrated year-over-year progress</u>: The utility has demonstrated sufficient progress on objectives and program targets reported in the prior annual WMP.
- <u>Forward-looking growth:</u> The utility demonstrates a clear action plan to continue reducing utility-related wildfires and the scale, scope, and frequency of Public Safety Power Shutoff (PSPS) events.<sup>16</sup> In addition, the utility is sufficiently focused on long-term strategies to build the overall maturity of its wildfire mitigation capabilities while reducing reliance on shorter-term strategies such as PSPS and vegetation management.

To conduct its assessment, the WSD relied upon TBC's WMP submission and the subsequent update, input from California Department of Forestry and Fire Protection (CAL FIRE), input from the Wildfire Safety Advisory Board (WSAB), public comments, responses to the WSD's data requests, utility-reported data, and utility responses to the Utility Maturity Survey.

Upon completion of its review, the WSD determined whether each utility's 2021 WMP Update should either be:

- Approved (approval may include the requirement to address certain issues in the utility's subsequent WMP and/or through existing ongoing reporting processes), or,
- Denied (the utility does not have an approved WMP Update for 2021 and must reapply for approval in 2022).

<sup>&</sup>lt;sup>16</sup> A Public Safety Power Shutoff (PSPS) event, also called a de-energization event, is when a utility proactively and temporarily cuts power to electric lines that may fail in certain weather conditions in specific areas to reduce electric facility-caused fire risk.

## 4. Cost Recovery

This document does not approve costs attributable to WMPs, as statute requires electrical corporations to seek cost recovery and prove all expenditures are just and reasonable at a future time in their General Rate Cases (GRC) or an appropriate application. Nothing in this Action Statement nor CPUC's Resolution should be construed as approval of any WMP-related costs.<sup>17</sup>

# 1. SUMMARY OF KEY FINDINGS

Pursuant to Public Utilities Code (Pub. Util. Code) Section 8386.3(a), this Action Statement is the totality of the WSD's review of TBC's 2021 WMP Update.

TBC's 2021 WMP Update is approved.

# 1.1. Areas of Significant Progress

The WSD finds that TBC has made significant progress over the past year and/or has matured in its mitigation strategies for future years in the following areas:

- TBC commissioned a third-party evaluation in 2020 to assess initiatives for fire protection capabilities and seismic upgrades to the main transformers. TBC implemented the evaluation's recommendation of storing additional fire suppression equipment at the Pittsburg substation.
- TBC installed transformer oil gas monitors at its Pittsburg station to track transformer health. These monitors proactively identify potential transformer vulnerabilities. This is in alignment with peer ITO.
- TBC installed a cable monitoring system to monitor the cable for physical vibration, temperature, and abnormal electrical discharge at the cable terminations.
- TBC contained its two converter stations with twelve foot, concrete perimeter walls to provide an additional layer of defense to prevent fire propagation.

# **1.2.** Revision Notices

The WSD did not elect to issue a Revision Notice to TBC in this WMP Update review cycle.

# 1.3. Key Areas for Improvement and Remedies

The WSD evaluated 2021 WMP Updates with a particular focus on how the utility's chosen mitigations and strategies will drive down the risk of utility-related wildfires as well as the scale,

<sup>&</sup>lt;sup>17</sup> The WSD's approval and the Commission's ratification do not relieve the electrical corporation from any and all otherwise applicable permitting, ratemaking, or other legal and regulatory obligations.

scope, and frequency of PSPS events. The WSD approves TBC's 2021 WMP Update and did not identify key areas for improvement.

The WSD did not identify key areas for improvement for TBC. In some evaluation sections, the WSD lists issues and associated remedies. All remedies must be addressed in TBC's 2022 WMP Update. The WSD expects TBC to take action to address these issues and report on progress made over the year in its 2022 WMP Update.

# 1.4. Maturity Model Evaluation

The Wildfire Safety Division introduced a maturity model (the Utility Wildfire Mitigation Maturity Model) in 2020, providing a method to assess utility wildfire risk reduction capabilities and examine the relative maturity of individual wildfire mitigation programs. In 2020, the utilities completed a survey setting a baseline for maturity as well as anticipated progress over the three-year plan period. In 2021, the utilities again completed the survey, enabling the WSD to monitor progress and ascertain potential improvements to maturity based on progress to date.

The WSD makes the following key findings regarding TBC's maturity progress in 2021:

- TBC reports no progress in maturity scores from 2020 to 2021.
- TBC projects sharp increases in maturity scores for 2022, despite no growth in 2021, for the following categories: risk assessment and mapping, data governance, emergency planning and preparedness, and stakeholder cooperation and community engagement.

# 2. WILDFIRE SAFETY ADVISORY BOARD INPUT

The Wildfire Safety Advisory Board (WSAB) provided recommendations on the WMPs of Pacific Gas and Electric Company, Southern California Edison Company (SCE), and San Diego Gas & Electric Company (SDG&E) on April 16, 2021.<sup>18</sup> The WSAB provided recommendations on the WMPs of the Bear Valley Electric Service, Inc. (BVES), PacifiCorp (PC), and Liberty Utilities, LLC. (Liberty) on May 13, 2021.<sup>19</sup> The WSAB did not comment on TBC's 2021 WMP Update.

<sup>18</sup> The WSAB's "Recommendations on the 2021 Wildfire Mitigation Plan Updates for Large Investor-Owned Utilities," approved April 14, 2021, and issued April 16, 2021, can be read here: <u>https://www.cpuc.ca.gov/uploadedFiles/CPUCWebsite/Content/About\_Us/Organization/Divisions/WSD/WSAB%2</u> ORecommendations%20on%202021%20Large%20IOU%20WMP%20Updates%20Issued%204.16.2021.pdf

<sup>&</sup>lt;sup>19</sup> The WSAB's "Recommendations on the 2021 Wildfire Mitigation Plan Updates for Small and Multi-Jurisdictional Utilities," approved May 12th, 2021, and issued May 13th, 2021, can be read here: <u>https://www.cpuc.ca.gov/uploadedFiles/CPUCWebsite/Content/About\_Us/Organization/Divisions/WSD/Draft%20</u> SMJU%20Recommendations%204-30-21.pdf

# 3. PUBLIC AND STAKEHOLDER COMMENT

On April 14, 2021, public comments were received for the SMJU/ITO 2021 WMP Updates. The WSD did not identify any significant issues specific to TBC within these comments.

# 4. **DISCUSSION**

The following sections discuss in detail the WMP, including progress over the past year, issues, and remedies to address by the next annual submission.

# 4.1. Introductory sections of the WMP

The first two sections of the WMP Guidelines<sup>20</sup> require the utility to report basic information regarding persons responsible for executing the plan and adherence to statutory requirements. Section 1 requires contact information (telephone and email) for the executive with overall responsibility and the specific program owners. In addition, all experts consulted in preparation of the WMP must be cited by name and include their relevant background/credentials. Contact information and names may be submitted in a redacted file.

Section 2 requires the utility to specify where each of the 22 requirements from Section 8386(c) of the Public Utilities Code are satisfied. Each utility shall both affirm that the WMP addresses each requirement AND cite the section and page number where it is more fully described.

The WSD did not identify key areas for improvement in the introductory sections of TBC's 2021 WMP Update, and the WSD finds that TBC has minimally satisfied all 22 requirements from Section 8386(c) of the Public Utilities Code.

# 4.2. Actuals and planned spending for Mitigation Plan

The WMP Guidelines<sup>21</sup> requires utilities to report a summary of WMP expenditures, planned and actual, for the current WMP cycle. This also includes an estimated annual increase in costs to the ratepayer due to utility-related wildfires and wildfire mitigation activities.<sup>22</sup> The WMP requires that ratepayer impact calculations are clearly shown to demonstrate how each value

 <sup>&</sup>lt;sup>20</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 14-21 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

 <sup>&</sup>lt;sup>21</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 22-24 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

<sup>&</sup>lt;sup>22</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, Section 3.2 "Summary of ratepayer impact," p. 23 (accessed June 2, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

was derived. Nothing in the request for such information should be construed as approval of any such expenditure, which is left to the CPUC pursuant to Pub. Util. Code Section 8386.4(b).

- TBC shows a small difference between its total 2020 planned spend and 2020 actual spend (\$11,322,000 to \$11,300,000).
- TBC reports \$0 spend in six initiative categories across the 2020-2022 WMP cycle:
  - Vegetation Management
  - Grid Operations and Protocols
  - Data Governance
  - Resource Allocation Methodology
  - Emergency Planning and Preparedness
  - o Stakeholder Cooperation and Community Engagement
- Consistent with its ITO peer, TBC's top three spend categories are (1) Grid Design and System Hardening, (2) Situational Awareness and Forecasting, and (3) Asset Management and Inspections.

# 4.3. Lessons learned and risk trends

This section of the WMP Guidelines<sup>23</sup> requires utilities to report how their plans have evolved since 2020 based on lessons learned, current risk trends, and research conducted. This section also requires utilities to report on potential future learnings through proposed and ongoing research.

Utilities must describe how the utility assesses wildfire risk in terms of ignition probability and estimated wildfire consequence using Commission adopted risk assessment requirements (for large electrical corporations) from the General Rate Case (GRC) Safety Model and Assessment Proceeding (S-MAP) and Risk Assessment Mitigation Phase (RAMP) at a minimum. The utility may additionally include other assessments of wildfire risk. The utility must:

- 1. Describe how it monitors and accounts for the contribution of weather and fuel to ignition probability and wildfire consequence.
- 2. Identify any areas where the Commission's High Fire Threat District (HFTD) should be modified.
- 3. Explain any "high fire threat" areas the utility considers that differ from Commissionadopted HFTD, and why such areas are so classified.
- 4. Rank trends anticipated to have the greatest impact on ignition probability and wildfire consequence.

 <sup>&</sup>lt;sup>23</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 24-29 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

TBC provided all required information on lessons learned, current risk trends, and research conducted.

 TBC commissioned a third-party evaluation of its off-site emergency response protocol. This evaluation revealed that transformer failures could potentially lead to difficult to extinguish fires and municipal fire departments are not likely to bring enough suppression materials to extinguish the fire in a timely manner. As a result, TBC purchased additional fire suppression equipment for its Pittsburg substation to ensure extinguishing materials are on site.<sup>24</sup>

# 4.4. Inputs to the plan and directional vision for WMP

This section of the WMP Guidelines<sup>25</sup> requires the utility to rank and discuss trends anticipated to exhibit the greatest impact on ignition probability and wildfire consequence within the utility's service territory over the next 10 years. First, utilities must set forth objectives over the following timeframes: before the upcoming wildfire season, before the next annual update, within the next 3 years, and within the next 10 years. Second and more practically, utilities must report the current and planned qualifications of their workforce they expect in order to meet these objectives.

# Goal, objectives, and program targets:

The goal of the WMP is shared across WSD and all utilities: documented reductions in the number of ignitions caused by utility actions or equipment and minimization of the societal consequences (with specific consideration of the impact on Access and Functional Needs populations and marginalized communities) of both wildfires and the mitigations employed to reduce them, including PSPS.

The WMP Guidelines<sup>26</sup> requires utilities to provide their objectives which are unique to each utility and reflect its 1, 3, and 10-year projections of progress toward the WMP goal. The WMP also requires utilities to report their unique program targets, which are quantifiable measurements of activity identified in WMPs and subsequent updates used to show progress toward reaching the objectives, such as number of trees trimmed or miles of power lines hardened.

<sup>&</sup>lt;sup>24</sup> TBC's 2021 WMP Update p.28

 <sup>&</sup>lt;sup>25</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 29-31(accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

 <sup>&</sup>lt;sup>26</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 29-30 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

TBC has provided all required information.

- TBC's WMP objectives have not changed since its 2020 WMP. The overarching objective "is to comply with applicable provisions of California Public Utilities Code (PU Code) Section 8386 at TBC's facilities."<sup>27</sup>
- TBC satisfies the requirement of presenting its 1, 3, and 10-year wildfire mitigation goals in Section 5.2 of its 2021 WMP Update. Before the next WMP Update, TBC's primary objective is to further harden its Pittsburg facility through enhanced fire suppression, awareness capabilities, and hardening assets to mitigate potential fire risks. Within the next 3 years, TBC plans to continue hardening efforts to its equipements and infrastructures and extend fire suppression improvements to auxiliary structures. In 10 years, TBC's objective is to achieve the highest level of Wildfire Mitigation Maturity given the scale and scope of its operations.<sup>28</sup>

## Workforce planning:

This subsection of the WMP Guidelines<sup>29</sup> requires utilities to report their worker qualifications and training practices regarding utility-related wildfire and PSPS mitigation for workers in mitigation-related roles including:

- 1. Vegetation inspections
- 2. Vegetation management projects
- 3. Asset inspections
- 4. Grid hardening
- 5. Risk event inspection

TBC provided all information required regarding worker qualifications within each of the required roles. TBC provides the worker titles, minimum qualifications, and full time employee (FTE) percentages by role for each of the mitigation-related roles listed above, except vegetation related roles as TBC does not have a vegetation management program.

# 4.5. Metrics and underlying data

The WMP Guidelines<sup>30</sup> require utilities to report metrics and program targets as follows:

<sup>&</sup>lt;sup>27</sup> TBC's 2021 WMP Update p. 39

<sup>&</sup>lt;sup>28</sup> TBC's 2021 WMP Update p. 40-41

 <sup>&</sup>lt;sup>29</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 30-31 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

 <sup>&</sup>lt;sup>30</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 32-41 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

- *Progress metrics* that track how much utility wildfire mitigation activity has managed to change the conditions of a utility's wildfire risk exposure in terms of drivers of ignition probability.
- Outcome metrics that measure the performance of a utility and its service territory in terms of both leading and lagging indicators of wildfire risk, PSPS risk, and other direct and indirect consequences of wildfire and PSPS, including the potential unintended consequences of wildfire mitigation work.
- *Program targets* measure tracking of proposed wildfire mitigation activities used to show progress toward a utility's specific objectives.<sup>31</sup> Program targets track the utility's pace of completing activities as laid out in the WMPs but do not track the efficacy of those activities. The primary use of these program targets in 2021 will be to gauge utility follow-through on existing WMPs.

This section also requires utilities to provide several geographic information system (GIS) files detailing spatial information about their service territory and performance, including recent weather patterns, location of recent ignitions, area and duration of PSPS events, location of lines and assets, geographic and population characteristics, and location of planned initiatives.

Discussion relating to TBC's metrics and data are contained within the data governance section of this document.

# 5. MITIGATION INITIATIVES AND MATURITY EVALUATION

This section of the WMP Guidelines<sup>32</sup> is the heart of the plan and requires the utility to describe each mitigation initiative it will undertake to reduce the risk of catastrophic wildfire. The utility is also required to self-report its current and projected progress to mitigate wildfire risk effectively,<sup>33</sup> a capability referred to in this document as "maturity" and measured by the WSD Utility Wildfire Mitigation Maturity Model ("Maturity Model"). Utility maturity is measured across the same categories used to report mitigation initiatives listed below, allowing WSD to evaluate a utility's reported and projected maturity in wildfire mitigation in the context of its corresponding current and planned initiatives. The ten maturity and mitigation initiative categories are listed below:


<sup>&</sup>lt;sup>31</sup> Objectives are unique to each utility and reflect the 1, 3, and 10-year projections of progress toward the WMP goal. See section 5.4 for review of the utility's objectives.

 <sup>&</sup>lt;sup>32</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 42-46 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.


<sup>&</sup>lt;sup>33</sup> Utilities that filed a WMP were required to complete a survey in which they answered specific questions which assessed their existing and future wildfire mitigation practices across 52 capabilities at the time of filing and at the end of the three-year plan horizon. The 52 capabilities are mapped to the same ten categories identified for mitigation initiatives. The results of the survey can be found in Attachment 11.1. The most recent survey for each utility can be found on the WSD website here: https://www.cpuc.ca.gov/wildfiremitigationplans/.

- 1) Risk assessment and mapping
- 2) Situational awareness and forecasting
- 3) Grid design and system hardening
- 4) Asset management and inspections
- 5) Vegetation management and inspections
- 6) Grid operations and operating protocols
- 7) Data governance
- 8) Resource allocation methodology
- 9) Emergency planning and preparedness
- 10) Stakeholder cooperation and community engagement

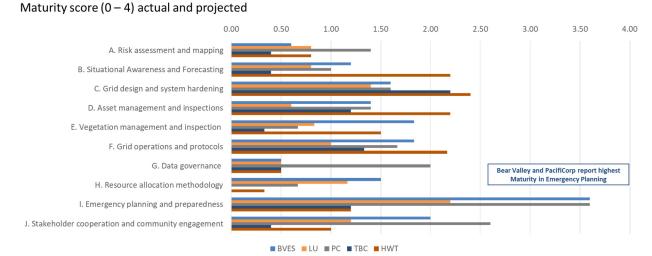

Source: 2021 Maturity Model survey data

# Figure 5.a: Self-reported Maturity by Category: SMJUs / ITOs

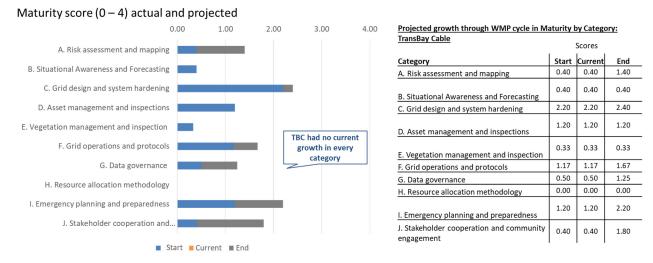

Source: 2021 Maturity Model survey data

Figure 5.b: Trans Bay Cable: Projected growth through WMP cycle in Maturity by Category

# 11

Below, WSD evaluates TBC's initiatives across the ten categories in the context of its maturity model survey scores.

# 5.1. Risk Assessment and Mapping

### Introduction

This section of the WMP Guidelines<sup>34</sup> requires the utility to discuss the risk assessment and mapping initiatives implemented to minimize the risk of its causing wildfires. Utilities must describe initiatives related to equipment maps and modelling of overall wildfire risk, ignition probability, wildfire consequence, risk-reduction impact, match-drop simulations,<sup>35</sup> and climate/weather-driven risks. This section also requires the utility to provide data on spending, miles of infrastructure treated, spend per treated line mile, ignition probability drivers targeted, projected risk reduction achieved from implementing the initiative, and other (i.e., non-ignition) risk drivers addressed by the initiative.

The parameters of risk assessment (discussed here) and resource allocation (discussed later in the "Resource Allocation Methodology" section) to reduce wildfire risk derive from the S-MAP and RAMP proceedings for the utility GRC (D.18-12-014).

The risk modelling conducted should ultimately inform the RSE analyses discussed in category 8, resource allocation methodology.

## Overview

TBC is a transmission-only facility with the majority of its facilities underwater or inside a substation, therefore it has minimal wildfire risk. The WSD finds that TBC has satisfactorily documented its risk assessment and mapping practices and finds this portion of TBC's 2021 WMP Update to be sufficient. Any changes in this category must be addressed in TBC's 2022 WMP Update.

## Progress over the past year

 <sup>&</sup>lt;sup>34</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 43-44 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.


<sup>&</sup>lt;sup>35</sup> Simulations of the potential wildfire consequences of ignitions that occur along electric lines and equipment effectively showing the potential consequences if an ignition or "match was dropped" at a specific point in a utility's territory.

The WSD finds that TBC has made the following progress:


 In 2020, TBC commissioned a third-party evaluation to assess initiatives for fire protection capabilities and seismic upgrades to the main transformers. TBC implemented the evaluation's recommendation of storing additional fire suppression equipment at the Pittsburg substation.

## Figure(s)

Maturity score (0 - 4) actual and projected

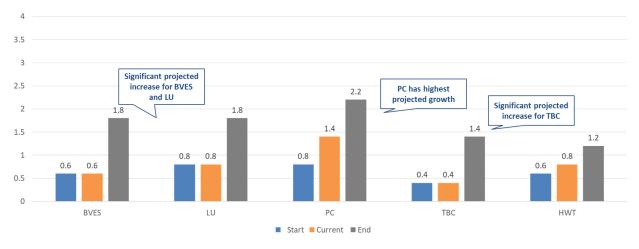

Source: 2021 Maturity Model survey data



## 5.2. Situational Awareness and Forecasting

### Introduction

A strong weather monitoring and situational awareness system is an essential fire prevention/mitigation risk reduction strategy because it effectively alerts a utility's preparation and response to potentially dangerous fire weather conditions that can inform its decisions on PSPS implementation, grid design, and system hardening. It is also one of the most inexpensive strategies.

The situational awareness and forecasting section of the WMP Guidelines<sup>36</sup> requires the utility to discuss its use of cameras, weather stations, weather forecasting and modeling tools, grid monitoring sensors, fault indicators, and equipment monitoring. Situational awareness requires the utility to be aware of actual ignitions in real time and to understand the likelihood of utility

<sup>&</sup>lt;sup>36</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, p. 44 (accessed May 27, 2021): https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

ignitions based on grid and asset conditions, wind, fuel conditions, temperature, and other factors.

The WMP Guidelines refer to key situational awareness measures, including:

- 1. Installation of advanced weather monitoring and weather stations that collect data on weather conditions so as to develop weather forecasts and predict where ignition and wildfire spread are likely;
- 2. Installation of high-definition cameras throughout a utility's service territory, with the ability to control the camera's direction and magnification remotely;
- 3. Use of continuous monitoring sensors that can provide near-real-time information on grid conditions;
- 4. Use of a fire risk or fire potential index that takes numerous data points in given weather conditions and predicts the likelihood of wildfire; and,
- 5. Use of personnel to physically monitor areas of electric lines and equipment in elevated fire risk conditions.

## Overview


TBC is a transmission-only facility with the majority of its equipment underwater or inside a substation, therefore has minimal wildfire risk. The WSD finds that TBC has satisfactorily documented its situational awareness and forecasting practices and finds this portion of TBC's 2021 WMP Update to be sufficient. Any changes in this category must be addressed in TBC's 2022 WMP Update.

## Progress over the past year

The WSD finds that TBC has made the following progress:


- TBC installed transformer oil gas monitors at its Pittsburg station to track transformer health. These monitors proactively identify potential transformer vulnerabilities. This is in alignment with its peer ITO.
- TBC installed a cable monitoring system to monitor the cable for physical vibration, temperature, and abnormal electrical discharge at the cable terminations. All of which may result in cable failure, fault, or potential derangement.

# Figure(s)

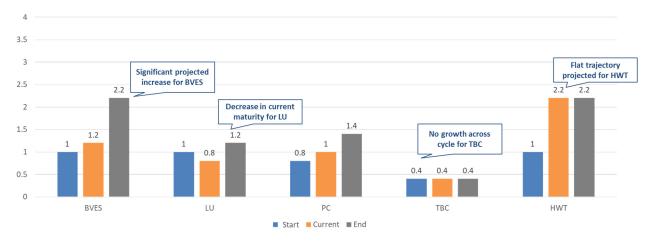

Maturity score (0 - 4) actual and projected

Source: 2021 Maturity Model survey data



## 5.3. Grid Design and System Hardening

#### Introduction

The grid design and system hardening section of the WMP Guidelines<sup>37</sup> examines how the utility is designing its system to reduce ignition risk and what it is doing to strengthen its distribution, transmission, and substation infrastructure to prevent causing catastrophic wildfires. This section also requires discussion of routine and non-routine maintenance programs, including whether the utility replaces or upgrades infrastructure proactively rather than running facilities to failure. Programs in this category, which often cover the most expensive aspects of a WMP, include initiatives such as the installation of covered conductors to replace bare overhead wires, undergrounding of distribution or transmission lines, and pole replacement programs. The utility is required, at a minimum, to discuss grid design and system hardening in each of the following areas:

- 1. Capacitor maintenance and replacement,
- 2. Circuit breaker maintenance and installation to de-energize lines upon detecting a fault,
- 3. Covered conductor installation,
- 4. Covered conductor maintenance,
- 5. Crossarm maintenance, repair, and replacement,
- 6. Distribution pole replacement and reinforcement, including with composite poles,
- 7. Expulsion fuse replacement,
- 8. Grid topology improvements to mitigate or reduce PSPS events,

<sup>&</sup>lt;sup>37</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, p. 44 (accessed May 27, 2021): https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

- 9. Installation of system automation equipment,
- 10. Maintenance, repair, and replacement of connectors, including hotline clamps,
- 11. Mitigation of impact on customers and other residents affected during PSPS event,
- 12. Other corrective action,
- 13. Pole loading infrastructure hardening and replacement program based on pole loading assessment program,
- 14. Transformer maintenance and replacement,
- 15. Transmission tower maintenance and replacement,
- 16. Undergrounding of electric lines and/or equipment,
- 17. Updates to grid topology to minimize risk of ignition in HFTDs, and,
- 18. Other/not listed items if an initiative cannot feasibly be classified within those listed above.

### Overview


Given the primarily undergrounded nature of TBC's system, the majority of hardening efforts are not applicable. The WSD finds that TBC has satisfactorily documented its grid design and system hardening efforts and finds this portion of TBC's 2021 WMP Update to be sufficient. Any changes in this category must be addressed in TBC's 2022 WMP Update.

### Progress over the past year

The WSD finds that TBC has made the following progress:


- TBC is converting its substations to gas insulated technology, which has less ignition risk than the current air insulated conductoring and bus-work.
- TBC has protective systems installed that work within microseconds in the event of a fault, as well as 24-hour System Operator oversight with manual shutdown power.
- TBC is installing transformer seismic upgrades to reduce ignitions as a result of seismic events. Upgrades should be completed in 2021.

Figure(s)

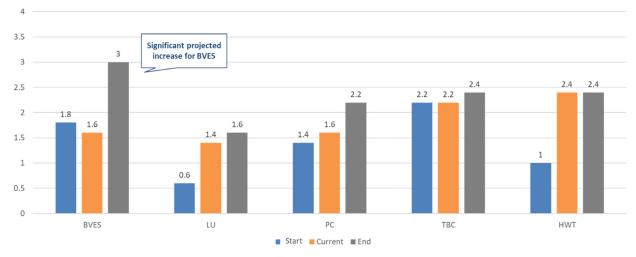

Maturity score (0 - 4) actual and projected

Source: 2021 Maturity Model survey data



## 5.4. Asset Management and Inspections

#### Introduction

The asset management and inspections portion of the WMP Guidelines<sup>38</sup> requires the utility to discuss power line/infrastructure inspections for distribution and transmission assets within the HFTD, including infrared, light detection and ranging (LiDAR), substation, patrol, and detailed inspections, designed to minimize the risk of its facilities or equipment causing wildfires. The utility must describe its protocols relating to maintenance of any electric lines or equipment that could, directly or indirectly, relate to wildfire ignition. The utility must also describe how it ensures inspections are done properly through a program of quality control.

### Overview


TBC performs frequent inspections, with particular focus on equipment that could pose a risk for wildfires as well as fire suppression systems. TBC reports that there has been no change to its asset management and inspections approach since the 2020 WMP.<sup>39</sup> The WSD finds that TBC has satisfactorily documented its asset management and inspections practices and finds this portion of TBC's 2021 WMP Update to be sufficient. Any changes in this category must be addressed in TBC's 2022 WMP Update.

 <sup>&</sup>lt;sup>38</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 44-45 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

<sup>&</sup>lt;sup>39</sup> TBC's 2021 WMP Update p. 57

## Figure(s)

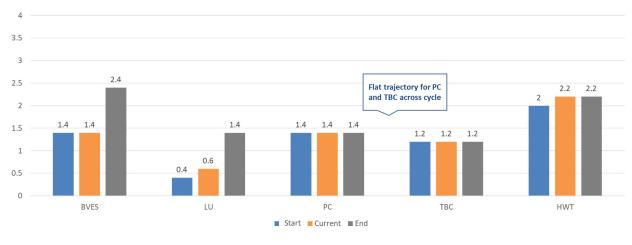

Maturity score (0 - 4) actual and projected

Source: 2021 Maturity Model survey data

*Figure 5.4.a: D. Asset management and inspections Maturity score progress* 

# 5.5. Vegetation Management and Inspections

## Introduction

This section of the WMP Guidelines<sup>40</sup> requires utilities to discuss vegetation management inspections, including inspections that go beyond existing regulation, as well as infrared, light detection and ranging (LiDAR), and patrol inspections of vegetation around distribution and transmission lines/equipment, quality control of those inspections, and limitations on the availability of workers. The utility must also discuss collaborative efforts with local land managers, including efforts to maximize benefit from fuel treatment activities and fire break creation as well as the collaborative development of methods for identifying at-risk vegetation, determining trim clearances beyond minimum regulations, and identifying and mitigating impacts from tree trimming and removal (erosion, flooding, etc.).


## Overview

TBC's facilities are in an urban/industrial environment and its transmission facilities are either buried or submerged beneath Bay Area waters. TBC does maintain vegetative fuels on its converter stations. The electrical corporation is a transmission-only facility with no distribution or customers. The majority of its facilities are underwater or inside a substation fence and has had no ignition incidents. The WSD finds that TBC has satisfactorily documented its vegetation

<sup>&</sup>lt;sup>40</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, p. 45 (accessed May 27, 2021): https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

management practices and protocols and finds this portion of TBC's 2021 WMP Update to be sufficient. Any changes in this category must be addressed in TBC's 2022 WMP Update.

## Figure(s)

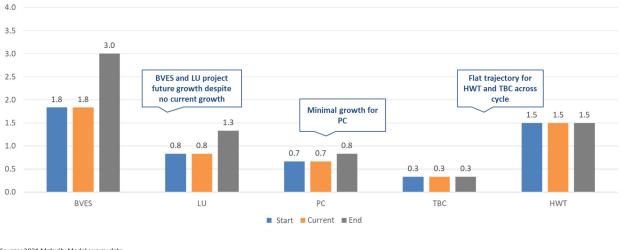

Maturity score (0 - 4) actual and projected

Source: 2021 Maturity Model survey data

Figure 5.5.a: E. Vegetation management and inspections Maturity score progress

# 5.6. Grid Operations and Operating Protocols, including PSPS

# Introduction

The grid operations and operating protocols section of the WMP Guidelines<sup>41</sup> requires discussion of ways the utility operates its system to reduce wildfire risk. For example, disabling the reclosing function of automatic reclosers<sup>42</sup> during periods of high fire danger (e.g., during Red Flag Warning conditions) can reduce utility ignition potential by minimizing the duration and amount of energy released when there is a fault. This section also requires discussion of work procedures in elevated fire risk conditions and protocols to reduce the frequency and scope of de-energization including PSPS events (e.g., through sectionalization, etc.). This section also requires the utility to report whether it has stationed and/or on-call ignition prevention and suppression resources and services.

<sup>&</sup>lt;sup>41</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, p. 45 (accessed May 27, 2021): https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

<sup>&</sup>lt;sup>42</sup> A recloser is a switching device that is designed to detect and interrupt momentary fault conditions. The device can reclose automatically and reopen if a fault condition is still detected. However, if a recloser closes a circuit that poses the risk of ignition, wildfire may be the result. For that reason, reclosers are disabled in certain high fire risk conditions. During overcurrent situations, circuit breakers trip a switch that shuts off power to the electrical line.

#### Overview


TBC primarily relies on its Emergency Operations Plan to cover its Grid Operations and Operating Protocols, with some upgrades being completed based on a third-party assessment to improve fire suppression response and systems. The WSD finds that TBC has satisfactorily documented its grid operations and protocols and finds this portion of TBC's 2021 WMP Update to be sufficient. Any changes in this category must be addressed in TBC's 2022 WMP Update.

### Progress over the past year

The WSD finds that TBC has made the following progress:

• TBC purchased and stationed additional fire suppression equipment at the Pittsburg substation after a third-party Wildfire Mitigation Assessment.<sup>43</sup> The third-party evaluation found that transformer failures could potentially lead to difficult to extinguish fires and municipal fire departments are not likely to bring enough suppression equipment to extinguish the fire.

### Figure(s)

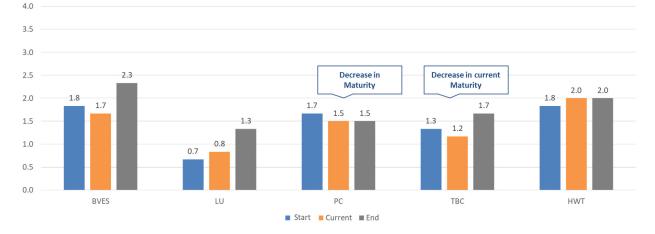

Maturity score (0 - 4) actual and projected

Source: 2021 Maturity Model survey data

Figure 5.6.a: F. Grid operations and protocols Maturity score progress

## 5.7. Data Governance

### Introduction

<sup>&</sup>lt;sup>43</sup> TBC's 2021 WMP Update p.66

The data governance section of the WMP Guidelines<sup>44</sup> requires information on the utility's initiatives to create a centralized wildfire-related data repository, conduct collaborative research on utility ignition and wildfire, document and share wildfire-related data and algorithms, and track and analyze near-miss data.

### Overview

The WSD finds that TBC has satisfactorily documented its data governance practices and finds this portion of TBC's 2021 WMP Update to be sufficient. Any changes in data governance practices or capabilities must be addressed in TBC's 2022 WMP Update.

### **Issues and Remedies**

While the WSD did not identify key areas for improvement in this category of TBC's 2021 WMP Update, the WSD finds the following issues and associated remedies. All remedies must be addressed in TBC's 2022 WMP Update. The WSD expects TBC to take action to address these issues and report on progress made over the year in its 2022 WMP Update.

 Issue: TBC reports maturity increases for data governance despite having no active initiatives in the data governance category and reporting no spend for the 2020-2022 WMP cycle. See summary Table 1 below for specific increases in maturity scores.

Capability	2021 Maturity Score	2022 Maturity Score
33. Data collection and curation	0	2
34. Data transparency and analytics	0	1

Table 1: TBC Data Governance Maturity Scores

Data source: 2021 Trans Bay Cable Utility Maturity Survey.<sup>45</sup>


 Remedy: TBC must justify the above maturity increases despite having no active initiatives in the data governance category and reporting no spend for the 2020-2022 WMP cycle.

Figure(s)

<sup>&</sup>lt;sup>44</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, p. 45 (accessed May 27, 2021): https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

<sup>&</sup>lt;sup>45</sup> See TBC's s 2021 response to the Maturity Survey (accessed April 29, 2021):

https://www.cpuc.ca.gov/uploadedFiles/CPUCWebsite/Content/About\_Us/Organization/Divisions/WSD/TBC%202 021%20Survey.pdf

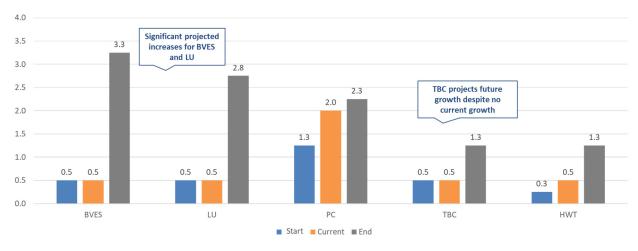

Maturity score (0 - 4) actual and projected

Source: 2021 Maturity Model survey data

Figure 5.7.a: G. Data governance Maturity score progress

## 5.8. Resource Allocation Methodology

#### Introduction

The resource allocation methodology section of the WMP Guidelines<sup>46</sup> requires the utility to describe its methodology for prioritizing programs by cost-efficiency. This section requires utilities to discuss risk reduction scenario analysis and provide a risk-spend efficiency (RSE) analysis for each aspect of the plan.


### Overview

The objectives of TBC's resource allocation strategy are focused on the prevention and detection of wildfire ignition risks and to enable prompt emergency response to TBC facilities. There have been no changes to TBC's resource allocation methodology since the 2020 WMP.<sup>47</sup> The WSD finds that TBC has satisfactorily documented its resource allocation methodology practices and finds this portion of TBC's 2021 WMP Update to be sufficient. Any changes in TBC's resource allocation practices or capabilities must be addressed in TBC's 2022 WMP Update.

## Figure(s)


<sup>&</sup>lt;sup>46</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, p. 45 (accessed May 27, 2021): https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

<sup>&</sup>lt;sup>47</sup> TBC's 2021 WMP Update p. 58

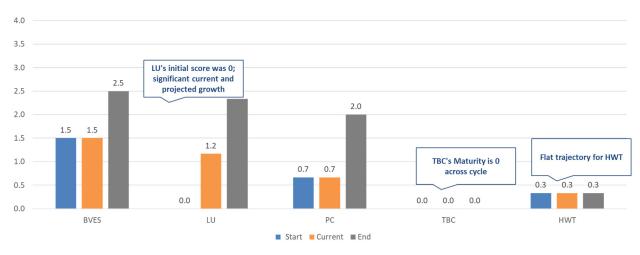

Maturity score (0 - 4) actual and projected

Source: 2021 Maturity Model survey data



## 5.9. Emergency Planning and Preparedness

#### Introduction

This section of the WMP Guidelines<sup>48</sup> requires a general description of the utility's overall emergency preparedness and response plan, including discussion of how the plan is consistent with legal requirements for customer support before, during, and after a wildfire, including support for low-income customers, billing adjustments, deposit waivers, extended payment plans, suspension of disconnection and nonpayment fees, and repairs. Utilities are also required to describe emergency communications before, during, and after a wildfire in languages deemed prevalent in a utility's territory (D.19-05-036, supplemented by D.20-03-004),<sup>49</sup> and other languages required by the Commission.

This section of the WMP also requires discussion of the utility's plans for coordination with first responders and other public safety organizations, plans to prepare for and restore service, including workforce mobilization and prepositioning of equipment and employees, and a showing that the utility has an adequately sized and trained workforce to promptly restore service after a major event.

<sup>&</sup>lt;sup>48</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, p. 46 (accessed May 27, 2021): https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

<sup>&</sup>lt;sup>49</sup> A language is prevalent if it is spoken by 1,000 or more persons in the utility's territory or if it is spoken by 5% or more of the population within a "public safety answering point" in the utility territory. See Cal. Government Code § 53112.

#### Overview

The WSD finds that TBC has satisfactorily documented its emergency planning and preparedness practices and capabilities. The WSD recommends that as TBC grows its footprint in California, TBC will evaluate and make appropriate changes to its disaster and emergency preparedness plan. TBC reports no changes to its emergency preparedness and planning practices since the 2020 WMP. Any changes in emergency planning and preparedness practices or capabilities must be addressed in TBC's 2022 WMP Update.

### **Issues and Remedies**

While the WSD did not identify key areas for improvement in this category of TBC's 2021 WMP Update, the WSD finds the following issues and associated remedies. All remedies must be addressed in TBC's 2022 WMP Update. The WSD expects TBC to take action to address these issues and report on progress made over the year in its 2022 WMP Update.

 Issue: TBC reports maturity increases for emergency preparedness and planning despite having no active initiatives in the emergency preparedness category and reporting no spend for the 2020-2022 WMP cycle. See summary Table 2 below for specific increases in maturity scores.

Capability	2021 Maturity Score	2022 Maturity Score
43. Wildfire plan integrated with	0	3
overall disaster/emergency plan		
46. Protocols in place to learn from	2	4
wildfire events		

Table 2: TBC Emergency Preparedness and Planning Maturity Scores


Data source: 2021 Trans Bay Cable Utility Maturity Survey.<sup>50</sup>

 Remedy: TBC must justify the above maturity increases despite having no active initiatives in the emergency preparedness and planning category and reporting no spend for the 2020-2022 WMP cycle.

Figure(s)

<sup>&</sup>lt;sup>50</sup> See TBC's 2021 response to the Maturity Survey (accessed April 29, 2021):

https://www.cpuc.ca.gov/uploadedFiles/CPUCWebsite/Content/About\_Us/Organization/Divisions/WSD/TBC%202 021%20Survey.pdf

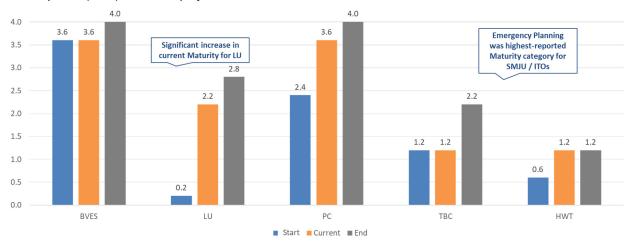

Maturity score (0 - 4) actual and projected

Source: 2021 Maturity Model survey data

Figure 5.9.a: I. Emergency planning and preparedness Maturity score progress

## 5.10.Stakeholder Cooperation and Community Engagement

### Introduction

The final initiative category in the WMP Guidelines<sup>51</sup> requires the utility to report on the extent to which it will engage the communities it serves and cooperate and share best practices with community members, agencies outside California, fire suppression agencies, forest service entities and others engaged in vegetation management or fuel reduction.

### Overview

As a transmission-only utility, TBC does not serve end-use customers or have a traditional service territory. Therefore, it does not provide customer support or engage with communities during an emergency. Despite not engaging directly with communities, TBC developed a communication and coordination protocol with its primary stakeholders (California Independent System Operator and Pacific Gas and Electric) where the president or designee will implement its communications protocols in the case of an emergency. TBC reports no changes to its stakeholder cooperation and community engagement practices since the 2020 WMP.

The WSD finds that TBC has satisfactorily documented its stakeholder cooperation and community engagement practices and capabilities. Any changes in stakeholder cooperation and

<sup>&</sup>lt;sup>51</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, p. 46 (accessed May 27, 2021): https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

community engagement practices or capabilities must be addressed in TBC's 2022 WMP Update.

### **Issues and Remedies**

While the WSD did not identify key areas for improvement in this category of TBC's 2021 WMP Update, the WSD finds the following issues and associated remedies. All remedies must be addressed in TBC's 2022 WMP Update. The WSD expects TBC to take action to address these issues and report on progress made over the year in its 2022 WMP Update.

 Issue: TBC reports maturity increases for stakeholder cooperation and community engagement despite having no active initiatives in this category and reporting no spend for the 2020-2022 WMP cycle. See summary Table 3 below for specific increases in maturity scores.

Capability	2021 Maturity Score	2022 Maturity Score
48. Cooperation and best practice	0	4
sharing with other utilities		
49. Engagement with communities	0	3
on utility wildfire mitigation		

 Table 3: TBC Stakeholder Cooperation and Community Engagement Maturity Scores


Data source: 2021 Trans Bay Cable Utility Maturity Survey.<sup>52</sup>


 Remedy: TBC must justify the above maturity increases despite having no active initiatives in the stakeholder cooperation and community engagement category and reporting no spend for the 2020-2022 WMP cycle.

## Figure(s)

<sup>52</sup> See TBC's 2021 response to the Maturity Survey (accessed April 29, 2021):

https://www.cpuc.ca.gov/uploadedFiles/CPUCWebsite/Content/About\_Us/Organization/Divisions/WSD/TBC%202 021%20Survey.pdf

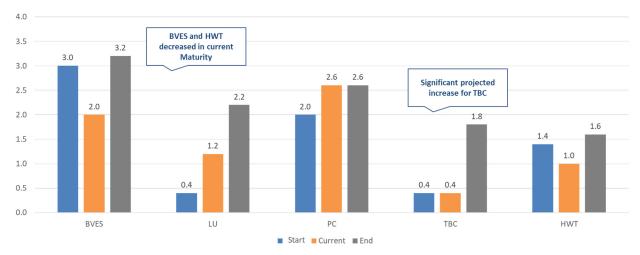



Source: 2021 Maturity Model survey data

*Figure 5.10.a: J. Stakeholder cooperation and community engagement Maturity score progress* 

# 6. PUBLIC SAFETY POWER SHUTOFF (PSPS), INCLUDING DIRECTIONAL VISION FOR PSPS

#### Introduction

In recent years, Public Safety Power Shutoffs (PSPS) have been increasingly used by utilities to mitigate wildfire risk. PSPS events introduce substantial risk to the public and impose a significant burden on public services that must activate during a PSPS event. The WSD supports the use of PSPS only as a last resort and expects the utilities to clearly present plans for reducing the scale, scope, and frequency of PSPS events.

In 2021, WSD separated the reporting of PSPS from the reporting of mitigations and progress metrics to reflect the definition of PSPS as a measure of last resort rather than a mitigation option (pursuant to Guidance Resolution WSD-002 and PSPS decisions D.19-05-036 and D.20-03-004).<sup>53</sup> This section of the WMP Guidelines<sup>54</sup> requires utilities to report their current and projected progress in PSPS mitigation, including lessons learned from the prior year, de-

<sup>&</sup>lt;sup>53</sup> When calculating RSE for PSPS, electrical corporations generally assume 100 percent wildfire risk mitigation and very low implementation costs because societal costs and impact are not included. When calculated this way, PSPS will always rise to the top as a wildfire mitigation tool, but it will always fail to account for its true costs to customers. Therefore, electrical corporations shall not rely on RSE calculations as a tool to justify the use of PSPS.

<sup>&</sup>lt;sup>54</sup> WSD-011 Attachment 2.2, 2021 Wildfire Mitigation Plan Guidelines Template, pp. 46-49 (accessed May 27, 2021):

https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M352/K460/352460864.pdf.

energization and re-energization protocols, PSPS outcome metrics, plans to reduce future PSPS impacts, and community engagement.

### Overview

TBC is a transmission-only utility and does not serve retail customers. TBC states that it anticipates no future need to call a PSPS event and reports no significant changes to its PSPS vision or implementation from its approved 2020 WMP. The WSD finds that TBC has satisfactorily documented its PSPS practices and capabilities. Any changes in its PSPS practices or capabilities must be addressed in TBC's 2022 WMP Update.

# 7. NEXT STEPS

TBC must address the issues identified in the WSD's review of TBC's 2021 WMP Update over the course of the next year. The WSD expects TBC to take action to address these issues and report on progress made over the year in its 2022 WMP Update.

### **Change Orders**

If TBC seeks to significantly modify (i.e., reduce, increase, or end) WMP mitigation measures in response to data and results on electrical corporation ignition risk reduction impacts, TBC must submit a Change Order Report. At a high level, the objective of the change order process is to ensure the electrical corporation continues to follow the most effective and efficient approach to mitigating its wildfire risk. This could change as new information becomes available and as the electrical corporation gains experience and measures the outcomes of its initiatives.

The change order process set forth herein provides a mechanism for the electrical corporation to make adjustments based on this information and experience. The goal of this process is to ensure that utilities make significant changes to their WMPs only if the utilities demonstrate these changes to be improvements per WMP approval criteria (i.e., completeness, technical feasibility, effectiveness, and resource use efficiency). Another goal of the change order process is to maximize the WSD's visibility and ability to respond to any significant changes to the approved plan as efficiently and in as streamlined a way as possible.

A "significant" change to a utility's WMP that would trigger the change order process is defined below:

A change falls into the following initiative categories, i) risk assessment and mapping, ii) vegetation management and inspections, iv) grid design and system hardening, or v) asset management and inspections.

<u>or</u>

• A change to the utility's PSPS strategy, protocols and/or decision-making criteria.

### <u>and</u>

• Meets one or more of the following criteria:

- A change that would result in an increase, decrease, or reallocation of more than \$5 million constituting a greater than 10% change in spend allocation.
- A change that reduces or increases the estimated risk reduction value of an initiative more than 25%.
- A change that results in a radical shift of either the strategic direction or purpose of an initiative (e.g., introducing use of a novel risk model that reverses the risk profile of the utility's circuits).

If an electrical corporation is unsure whether a change is significant, the corporation is encouraged to submit an advance inquiry on the matter. The change order process is not intended to provide electrical corporations with a pass to unilaterally change their WMP initiatives and program targets; rather, its purpose is to provide a mechanism for refining certain elements of WMP initiatives when there is demonstrable quantitative and qualitative justification for doing so.

Utilities shall submit any Change Order Reports by November 1, 2021. The WSD will review change orders and may issue either an approval or a denial if proposed changes are deemed to be materially out of alignment with the WSD's goals.

At a minimum, each proposed change order shall provide the following information:

- i.The proposed change
  - a. The initiative being altered with reference to where in the WMP the initiative is discussed
  - b. The planned budget of that initiative, including:
    - i.Planned spend in the 2021 WMP Update of the initiative being altered
    - ii.Of the planned spend identified in i. above, how much has already been spent
    - iii.Planned spend for the remainder of the WMP plan periodiv.If spend is being redeployed, how much is being redeployed and to/from which budget
  - c. The type of change being proposed, reported as one of the following:
    - i.Increase in scale
    - ii.Decrease in scale
    - iii.Change in prioritization
    - iv.Change in deployment timing
    - v.Change in work being done
    - vi.Other change (described)
  - d. A detailed description of the proposed change
- ii.Justification for the proposed change
  - a. In what way, if any, does the change address or improve:
    - i.Completeness
    - ii.Technical feasibility of the initiative
    - iii.Effectiveness of the initiative

iv.Resource use efficiency over portfolio of WMP initiatives iii.Change in expected outcomes from the proposed change

a. What outcomes, including quantitative ignition probability and PSPS risk reduction, was the changed initiative expected to achieve in the 2021 WMP Update?

b. What outcomes, including quantitative ignition probability and PSPS risk reduction, will the initiative deliver with the proposed adjustment?

Submission of Change Order Reports shall be submitted by e-mail to the Director of Energy Safety. [Energy Safety and the submission e-mail address shall be established by July 1<sup>st</sup>, 2021]. Utilities shall concurrently serve all reports on the Department of Forestry and Fire Protection at <u>CALFIREUtilityFireMitigationUnit@fire.ca.gov</u> and on the service list in R.18-10-007, consistent with the procedures set forth in Rules 1.9 and 1.10 of the Commission's Rules of Practice and Procedure.

Stakeholders may comment on Change Order Reports within fifteen days of submission following the submission instructions above but may not otherwise seek change orders through this-process. The WSD may modify the process for submitting or reviewing change orders at its discretion with written notice.

# 8. CONSULTATION WITH CAL FIRE

Pub. Util. Code Section 8386.3(a) requires the WSD to consult with CAL FIRE in reviewing electrical corporations' 2021 WMP Updates. The Commission and CAL FIRE have a memorandum of understanding in place to facilitate this consultation (Pub. Util. Code Section 8386.5). The Commission and the WSD have met these requirements, but this Action Statement does not purport to speak for CAL FIRE.

# 9. CONCLUSION

# TBC's 2021 WMP Update is approved.

Catastrophic wildfires remain a serious threat to the health and safety of Californians. Electrical corporations, including TBC, must continue to make progress toward reducing utility-related wildfire risk. Through the approval of TBC's 2021 WMP submission, the WSD expects TBC to effectively implement its wildfire mitigation activities to reduce the risk of utility-related ignitions and the potential catastrophic consequences if an ignition occurs as well as to reduce the scale, scope, and frequency of PSPS events. TBC must meet the commitments in its 2020 WMP and fully comply with the conditions listed in this Action Statement to ensure it is achieving a meaningful reduction of utility-related wildfire and PSPS risk within its service territory.

## /S/ CAROLINE THOMAS JACOBS

Caroline Thomas Jacobs Director, Wildfire Safety Division California Public Utilities Commission

## **10. APPENDIX**

## 10.1. Status of 2020 WMP Deficiencies

The 2020 WMP Resolutions for each utility contained a set of "Deficiencies" and associated "Conditions" to remedy those issues. Each issue was categorized into one of the following classes, with Class A being the most serious:

- Class A aspects of the WMP are lacking or flawed;
- Class B insufficient detail or justification provided in the WMP;
- Class C gaps in baseline or historical data, as required in the 2020 WMP Guidelines.

Class A deficiencies were of the highest concern and required a utility to develop and submit to the WSD a Remedial Compliance Plan (RCP) to resolve the identified issue within 45 days of Commission ratification of the Resolution. Class B deficiencies were of medium concern and required reporting by the utility to provide missing data or a progress update in its Quarterly Report. Such reporting was either on a one-time basis or ongoing as set forth in each condition. Class C deficiencies required the utility to submit additional detail and information or otherwise come into compliance in its following annual WMP Update. Detailed descriptions of the RCP and quarterly reports are contained in Resolution WSD-002, the Guidance Resolution on Wildfire Mitigation Plans.<sup>55</sup>

Deficiencies have either been resolved or are folded into 2021 issues, as detailed in the table below.

The WSD issued a full approval of TBC's 2020 WMP with no identified deficiencies.

<sup>&</sup>lt;sup>55</sup> The Draft Guidance Resolution WSD-002 can be found here on the CPUC website: https://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M336/K461/336461968.pdf

# **11. ATTACHMENTS**

## 11.1. Attachment 1: TBC's 2021 Maturity Survey

## 11.1.1. TBC: Description of Data Sources

Data related to the Maturity Model is based on the latest submitted versions of 2021 Utility Wildfire Mitigation Maturity Survey ("Survey") as of May 5, 2021. Data for the Maturity Model is pulled from Survey responses unless stated otherwise.

All source data (the WMP and the Survey responses) are available at: <u>https://www.cpuc.ca.gov/wildfiremitigationplans/</u>.

All the analysis and corresponding tables presented in this appendix rely upon data that is self-reported by the utilities. By utilizing and presenting this self-reported data in this appendix, the WSD is not independently validating that all data elements submitted by utilities are accurate. The WSD will continue to evaluate utility data, conduct data requests, and conduct additional compliance activities to ensure that data provided is accurate.

# **11.1.2.** TBC: Introduction to Maturity model scoring<sup>56</sup>

In order to determine "maturity" in any one capability, the WSD assigned levels to each aspect of the electrical corporations' wildfire mitigation efforts. Each capability was assigned a level, from 0 - 4 range, with 0 being the lowest and 4 the highest. The WSD calculated a maturity level, in accordance with the required elements to achieve each level, as outlined in the maturity model rubric.

The levels were calculated using an "all or nothing" binary approach. That is, levels are reported as whole numbers only.<sup>57</sup> Thus, in order to reach a specific maturity level, an electrical corporation would have to meet 100 percent of the threshold requirements for that level, as detailed in the maturity model rubric. In general, the maturity model rubric outlines numerous elements that are required to be met to achieve a given level, and the sophistication of requirements to reach a level typically increases with each successively higher maturity level.

For example, to obtain a level of 1 in Capability 24 of the 52 total capabilities, titled "Vegetation grow-in mitigation," the electrical corporation (or utility) must demonstrate the following: "[u]tility maintains vegetation around lines and equipment according to minimum statutory and regulatory clearances. Utility: i) removes vegetation waste along right of ways and ii) within 1 week of cutting vegetation across entire grid."

<sup>&</sup>lt;sup>56</sup> From WSD-002 p. 10-11

<sup>&</sup>lt;sup>57</sup> Note: The category averages shown in 11.1.3 (below) average the capability scores and may include decimals.

Thus, in order to receive a maturity level of 1 for Capability 24, an electrical corporation would not only have to maintain minimum regulatory clearances around its overhead lines but also remove the vegetation waste along its right of ways within one week of conducting vegetation clearance work. If an electrical corporation meets only one of these requirements, then it would be assigned the next lowest level. In this example, a level of 0 would be assigned and the electrical corporation would not receive "partial credit" towards a level of 1.

#### 11.1.3. TBC: Maturity detail by capability



## Category A. Risk Assessment and Mapping

	Avg cycle start maturity: 0.4	Avg current maturity: 0.4	Avg projected cycle end maturity: 1.4
	Capability 1. Climate	scenario modeling	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)
	Responses to survey questions and the utility		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
1a: How sophisticated is utility's ability to estimate the risk of weather scenarios?	ii. Wildfire risk can be reliably determined based on weather and its impacts	<ul> <li>ii. Wildfire risk can be reliably</li> <li>determined based on weather</li> <li>and its impacts</li> </ul>	<ul> <li>ii. Wildfire risk can be reliably</li> <li>determined based on weather and its</li> <li>impacts</li> </ul>
1b: How are scenarios assessed?	<ul> <li>iii. Independent expert assessment,</li> <li>supported by historical data of incidents and</li> <li>near misses</li> </ul>	iii. Independent expert assessment, supported by historical data of incidents and near misses	iii. Independent expert assessment, supported by historical data of incidents and near misses
1c: How granular is utility's ability to model scenarios?	v. Asset-based	v. Asset-based	v. Asset-based
1d: How automated is the tool?	i. Not automated	i. Not automated	i. Not automated
1e: What additional information is used to estimate model weather scenarios and their risk?	v. Weather measured at the circuit level, how weather effects failure modes and propagation, existing hardware, level of vegetation	v. Weather measured at the circuit level, how weather effects failure modes and propagation, existing hardware, level of vegetation	v. Weather measured at the circuit level, how weather effects failure modes and propagation, existing hardware, level of vegetation

1f: To what extent is future change in climate taken into account for future risk estimation?	i. Future climate change not accounted for in estimating future weather and resulting risk	<ul> <li>Future climate change not accounted for in estimating future weather and resulting risk</li> </ul>	<ul> <li>ii. Future risk estimates take into account generally higher risk across entire service territory due to changing climate</li> </ul>
--	--	---	---

	Capability 2. Ignitio	on risk estimation	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su	rvey questions	
	Survey questions and the utility	's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
2a: How is ignition risk calculated? 2b: How automated is the	ii. Tools and processes can reliably categorize the risk of ignition across the grid into at least two categories based on characteristics and condition of lines, equipment, surrounding vegetation, and localized weather patterns	ii. Tools and processes can reliably categorize the risk of ignition across the grid into at least two categories based on characteristics and condition of lines, equipment, surrounding vegetation, and localized weather patterns	ii. Tools and processes can reliably categorize the risk of ignition across the grid into at least two categories based on characteristics and condition of lines, equipment, surrounding vegetation, and localized weather patterns
ignition risk calculation tool?	i. Not automated	i. Not automated	i. Not automated
2c: How granular is the tool?	v. Asset-based	v. Asset-based	v. Asset-based
2d: How is risk assessment confirmed? Select all that apply.	i. By experts ii. By historical data	i. By experts ii. By historical data	i. By experts ii. By historical data

Attachments-4

2e: What confidence interval, in		> COV or no quantified confidence	
percent, does the utility use in		>60%, or no quantified confidence	
its wildfire risk assessments?	>60%, or no quantified confidence interval	interval	>90%

	Capability 3. Estimation of wildfin	e consequences for communities	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su		
Question	Survey questions and the utility Start of cycle	By end of year 1 (current)	Planned state by end of cycle
3a: How is estimated consequence of ignition relayed?	iv. Consequence of ignition events quantitatively, accurately, and precisely estimated	iv. Consequence of ignition events quantitatively, accurately, and precisely estimated	iv. Consequence of ignition events quantitatively, accurately, and precisely estimated
3b: What metrics are used to estimate the consequence of ignition risk?	i. As a function of at least one of the following: structures burned, potential fatalities, or area burned	i. As a function of at least one of the following: structures burned, potential fatalities, or area burned	iii. As a function of at least potential fatalities, structures burned, area burned, monetary damages, impact on air quality, and impact on GHG reduction goals
3c: Is the ignition risk impact analysis available for all seasons?	ii. Yes	ii. Yes	ii. Yes
3d: How automated is the ignition risk estimation process?	i. Not automated	i. Not automated	i. Not automated
3e: How granular is the ignition risk estimation process?	v. Asset-based	v. Asset-based	v. Asset-based
3f: How are the outputs of the ignition risk impact assessment tool evaluated?	iii. Outputs independently assessed by experts and confirmed by historical data	iii. Outputs independently assessed by experts and confirmed by historical data	iii. Outputs independently assessed by experts and confirmed by historical data

Г

3g: What other inputs are used to estimate impact?	i. Level and conditions of vegetation and weather, including the vegetation specifies immediately surrounding the ignition site	i. Level and conditions of vegetation and weather, including the vegetation specifies immediately surrounding the ignition site	iii. Level and conditions of vegetation and weather, including the vegetation specifies immediately surrounding the ignition site and up-to-date moisture content, local weather patterns
--	---	---	---

	Capability 4. Estimation of wildfire	and PSPS risk-reduction impact	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 3 (projected)
	<b>Responses to su</b> Survey questions and the utility		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
4a: How is risk reduction impact estimated?	iii. Approach reliably estimates risk reduction potential of initiatives on an interval scale (e.g. specific quantitative units)	<ul> <li>iii. Approach reliably estimates</li> <li>risk reduction potential of</li> <li>initiatives on an interval scale</li> <li>(e.g. specific quantitative units)</li> </ul>	iv. Approach reliably estimates risk reduction potential of initiatives on an interval scale (e.g. specific quantitative units) with a quantitative confidence interval
4b: How automated is your ignition risk reduction impact assessment tool?	i. Not automated	i. Not automated	iii. Mostly (>=50%)
4c: How granular is the ignition risk reduction impact assessment tool?	v. Asset-based	v. Asset-based	v. Asset-based
4d: How are ignition risk reduction impact assessment tool estimates assessed?	ii. With evidence and logical reasoning	ii. With evidence and logical reasoning	iv. Independent expert assessment, supported by historical data of incidents and near misses

4e: What additional information is used to estimate risk reduction impact?	iii. Existing hardware type and condition, including operating history	iv. Existing hardware type and condition, including operating history; level and condition of vegetation; weather	v. Existing hardware type and condition, including operating history; level and condition of vegetation; weather; and combination of initiatives already deployed

	Capability 5. Risk maps ar	nd simulation algorithms	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	Planned state by end of cycle: 3 (projected)
	<b>Responses to su</b> Survey questions and the utility	<i>·</i> ·	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
5a: What is the protocol to update risk mapping algorithms? 5b: How automated is the	i. No defined process for updating risk mapping algorithms	i. No defined process for updating risk mapping algorithms	ii. Risk mapping algorithms updated based on detected deviations of risk model to ignitions and propagation
mechanism to determine whether to update algorithms based on deviations?	i. Not automated	i. Not automated	iii. Mostly (>=50%)
5c: How are deviations from risk model to ignitions and propagation detected?	i. Not currently calculated	i. Not currently calculated	iii. Semi-automated process
5d: How are decisions to update algorithms evaluated?	i .Not currently evaluated	i .Not currently evaluated	<li>iii. Independently evaluated by experts and historical data</li>

	5e: What other data is used to		iii. Current and historic ignition	
undate algorithms? propagation data: poor miss data data	make decisions on whether to	iii. Current and historic ignition and	and propagation data; near-miss	iii. Current and historic ignition and
update algorithms: propagation data, near-miss data data propagation data, near-miss data	update algorithms?	propagation data; near-miss data	data	propagation data; near-miss data

## Category B. Situational Awareness and Forecasting

	Avg cycle start maturity: 0.4	Avg current maturity: 0.4	Avg projected cycle end maturity: 0.4
	Capability 6. Weather	r variables collected	
Capability maturity level based			
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su	rvey questions	
	Survey questions and the utility	's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
6a: What weather data is currently collected?	i. Wind data being collected is insufficient to properly understand wind related risks along grid	i. Wind data being collected is insufficient to properly understand wind related risks along grid	i. Wind data being collected is insufficient to properly understand wind related risks along grid
6b: How are measurements validated?	i. Measurements not currently validated	i. Measurements not currently validated	i. Measurements not currently validated
6c: Are elements that cannot be reliably measured in real time being predicted (e.g., fuel moisture content)?	i. No	i. No	i. No
6d: How many sources are being used to provide data on weather metrics being collected?	i. None	i. None	i. None

	Capability 7. Weatl	ier data resolution	
Capability maturity level based			
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su	irvey questions	
	Survey questions and the utility	y's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
		i. Weather data collected does	
	i. Weather data collected does not	not accurately reflect local	i. Weather data collected does not
7a: How granular is the weather	accurately reflect local weather conditions	weather conditions across grid	accurately reflect local weather
data that is collected?	across grid infrastructure	infrastructure	conditions across grid infrastructure
7b: How frequently is data			
gathered	i. Less frequently than hourly	i. Less frequently than hourly	i. Less frequently than hourly
	i. Less granular than regional, or no tool at	i. Less granular than regional, or	i. Less granular than regional, or no tool
7c: How granular is the tool?	all	no tool at all	at all
7d: How automated is the			
process to measure weather			
conditions?	i. Not automated	i. Not automated	i. Not automated

	Capability 8. Weather	r forecasting ability	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su		
<u> </u>	Survey questions and the utility	•	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
8a: How sophisticated is the utility's weather forecasting capability?	i. No reliable independent weather forecasting ability	i. No reliable independent weather forecasting ability	i. No reliable independent weather forecasting ability
8b: How far in advance can accurate forecasts be prepared?	i. Less than two weeks in advance	i. Less than two weeks in advance	i. Less than two weeks in advance
8c: At what level of granularity can forecasts be prepared?	i. Less granular than regional, or no forecasts at all	i. Less granular than regional, or no forecasts at all	i. Less granular than regional, or no forecasts at all
8d: How are results error-	. Desults are not even sheeled	i. Results are not error checked	i. Results are not error checked
checked?	i. Results are not error checked	I. Results are not error checked	I. Results are not error checked
8e: How automated is the	i. Not automated	i. Not automated	i. Not automated

Capability 9. External sources used in weather forecasting				
Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)		
<b>Responses to survey questions</b> Survey questions and the utility's responses are shown below				
Start of cycle	By end of year 1 (current)	Planned state by end of cycle		
ii. External data used where direct measurements from utility's own weather stations are not available	ii. External data used where direct measurements from utility's own weather stations are not available	ii. External data used where direct measurements from utility's own weather stations are not available		
i. Weather station data is not checked for errors	i. Weather station data is not checked for errors	i. Weather station data is not checked for errors		
i. Weather data is used to make decisions	i. Weather data is used to make decisions	i. Weather data is used to make decisions		
	Start of cycle: 1 Responses to su Survey questions and the utility Start of cycle ii. External data used where direct measurements from utility's own weather stations are not available i. Weather station data is not checked for errors	Start of cycle: 1By end of year 1 (current): 1Responses to survey questions Survey questions and the utility's responses are shown belowStart of cycleBy end of year 1 (current)ii. External data used where direct measurements from utility's own weather stations are not availableii. External data used where direct measurements from utility's own weather stations are not availablei. Weather station data is not checked for errorsi. Weather station data is not checked for errorsi. Weather data is used to make		

Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)
	<b>Responses to su</b> Survey questions and the utility		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
10 : Are there well-defined procedures for detecting			
ignitions along the grid?	ii. Yes	ii. Yes	ii. Yes
10b: What equipment is used to detect ignitions?	<ul> <li>iii. Well-defined equipment for detecting</li> <li>ignitions along grid, including remote</li> <li>detection equipment including cameras</li> </ul>	<ul> <li>iii. Well-defined equipment for detecting ignitions along grid, including remote detection equipment including cameras</li> </ul>	<ul> <li>iii. Well-defined equipment for detecting ignitions along grid, including remote detection equipment including cameras</li> </ul>
10 : How is information on detected ignitions reported?	iii. Procedure exists for notifying suppression forces and key stakeholders	<ul> <li>iii. Procedure exists for notifying suppression forces and key stakeholders</li> </ul>	iii. Procedure exists for notifying suppression forces and key stakeholders
10d: What role does ignition detection software play in wildfire detection?	i. Ignition detection software not currently deployed	i. Ignition detection software not currently deployed	i. Ignition detection software not currently deployed

## Category C. Grid design and system hardening

	Avg cycle start maturity: 2.2	Avg current maturity: 2.2	Avg projected cycle end maturity: 2.4
	Capability 11. Approach to priorit		Avg projecteu cycle enu maturity. 2.4
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 4	By end of year 1 (current): 4	Planned state by end of cycle: 4 (projected)
	<b>Responses to su</b> Survey questions and the utility		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
11a: How are wildfire risk reduction initiatives prioritized?	v. Plan prioritizes wildfire risk reduction initiatives at the asset level based on i) risk modeling driven by local geography and climate/weather conditions, fuel loads and moisture content and topography ii) risk estimates across individual circuits, including estimates of actual consequence, and iii) taking power delivery uptime into account (e.g. reliability, PSPS, etc.)	v. Plan prioritizes wildfire risk reduction initiatives at the asset level based on i) risk modeling driven by local geography and climate/weather conditions, fuel loads and moisture content and topography ii) risk estimates across individual circuits, including estimates of actual consequence, and iii) taking power delivery uptime into account (e.g. reliability, PSPS, etc.)	v. Plan prioritizes wildfire risk reduction initiatives at the asset level based on i) risk modeling driven by local geography and climate/weather conditions, fuel loads and moisture content and topography ii) risk estimates across individual circuits, including estimates of actual consequence, and iii) taking power delivery uptime into account (e.g. reliability, PSPS, etc.)

Capability 12. Grid design for minimizing ignition risk			
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 3	By end of year 1 (current): 3	Planned state by end of cycle: 3 (projected)
	Responses to su		
	Survey questions and the utility	•	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
12a: Does grid design meet	iii. Grid topology exceeds design	iii. Grid topology exceeds design	iii. Grid topology exceeds design
minimum G095 requirements	requirements, designed based on accurate	requirements, designed based on	requirements, designed based on
and loading standards in HFTD	understanding of drivers of utility ignition	accurate understanding of drivers	accurate understanding of drivers of
areas?	risk	of utility ignition risk	utility ignition risk
12b: Does the utility provide micro grids or islanding where traditional grid infrastructure is impracticable and wildfire risk is high?	i. No	i. No	i. No
	1. NO	1. NO	1. 110
12c: Does routing of new portions of the grid take wildfire			
risk into account?	i. Yes	i. Yes	i. Yes
12d: Are efforts made to incorporate the latest asset		iii. Yes, across the entire service	
management strategies and new		III. Yes, across the entire service	

Capability 13. Grid design for resiliency and minimizing PSPS			
d of cycle			
offoiluro			
of failure			
of failure			
of failure			
of fa			

Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 3	By end of year 1 (current): 3	Planned state by end of cycle: 3 (projected)
	Responses to su	irvey questions	
	Survey questions and the utility	y's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
14a: Does the utility have an understanding of the risk spend efficiency of hardening initiatives?	iii. Utility has an accurate understanding of the relative cost and effectiveness of different initiatives, tailored to the circumstances of different locations on its grid	<ul> <li>iii. Utility has an accurate understanding of the relative cost and effectiveness of different initiatives, tailored to the circumstances of different locations on its grid</li> </ul>	iii. Utility has an accurate understanding of the relative cost and effectiveness of different initiatives, tailored to the circumstances of different locations on its grid
14b: At what level can estimates be prepared?	v. Asset-based	v. Asset-based	v. Asset-based
14c: How frequently are estimates updated?	iii. Annually or more frequently	iii. Annually or more frequently	iii. Annually or more frequently
14d: What grid hardening initiatives does the utility include within its evaluation? 14e: Can the utility evaluate risk	iv. All	iv. All	iv. All
reduction synergies from combination of various initiatives?	ii. Yes	ii. Yes	ii. Yes

Capability 15. Grid design and asset innovation			
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 2 (projected)
	Responses to su	urvey questions y's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
15 : How are new hardening solution initiatives evaluated? 15b: Are results of pilot and commercial deployments, including project performance, project cost, geography, climate, vegetation etc. shared in	ii. New initiatives evaluated based on installation into grid and measuring direct reduction in ignition events	ii. New initiatives evaluated based on installation into grid and measuring direct reduction in ignition events	iii. New initiatives evaluated based on installation into grid and measuring direct reduction in ignition events, and measuring reduction impact on near- miss metrics
sufficient detail to inform decision making at other utilities?	i. No	i. No	i. No
15 : Is performance of new initiatives independently audited?	i. No	i. No	i. No

## Category D. Asset management and inspections

	Avg cycle start maturity: 1.2	Avg current maturity: 1.2	Avg projected cycle end maturity: 1.2
	Capability 16. Asset inventory	and condition assessments	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su		
	Survey questions and the utility	's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
16a: What information is captured in the equipment inventory database?	iii. There is an accurate inventory of equipment that may contribute to wildfire risk, including age, state of wear, and expected lifecycle, including records of all inspections and repairs	iii. There is an accurate inventory of equipment that may contribute to wildfire risk, including age, state of wear, and expected lifecycle, including records of all inspections and repairs	v. There is an accurate inventory of equipment that may contribute to wildfire risk, including age, state of wear, and expected lifecycle, including records of all inspections and repairs and up-to-date work plans on expected future repairs and replacements wherein repairs and sensor outputs are independently audited
16 : How frequently is the condition assessment updated?	ii. Annually	ii. Annually	ii. Annually
16c: Does all equipment in HFTD areas have the ability to detect and respond to malfunctions?	iv. Sensorized, continuous monitoring equipment is in place to determine the state of equipment and reliably detect incipient malfunctions likely to cause ignition, with the ability to de-activate electric lines and equipment exhibiting such failure	iv. Sensorized, continuous monitoring equipment is in place to determine the state of equipment and reliably detect incipient malfunctions likely to cause ignition, with the ability to de-activate electric lines and equipment exhibiting such failure	iv. Sensorized, continuous monitoring equipment is in place to determine the state of equipment and reliably detect incipient malfunctions likely to cause ignition, with the ability to de-activate electric lines and equipment exhibiting such failure
16 : How granular is the inventory?	iii. At the asset level	iii. At the asset level	iii. At the asset level

	Capability 17. Asset inspection cycle			
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)	
	<b>Responses to su</b> Survey questions and the utility			
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
17a: How frequent are your patrol inspections?	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	
17b: How are patrol inspections scheduled?	i. Based on annual or periodic schedules	i. Based on annual or periodic schedules	i. Based on annual or periodic schedules	
17c: What are the inputs to scheduling patrol inspections?	i. At least annually updated or verified static maps of equipment and environment	<ul> <li>At least annually updated or verified static maps of equipment and environment</li> </ul>	i. At least annually updated or verified static maps of equipment and environment	
17d: How frequent are detailed inspections?	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	
17e: How are detailed inspections scheduled?	i. Based on annual or periodic schedules	i. Based on annual or periodic schedules	i. Based on annual or periodic schedules	
17f: What are the inputs to scheduling detailed inspections?	i. At least annually updated or verified static maps of equipment and environment	i. At least annually updated or verified static maps of equipment and environment	i. At least annually updated or verified static maps of equipment and environment	
17g: How frequent are your other inspections?	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	iii. Above minimum regulatory requirements, with more frequent inspections for highest risk equipment	
17h: How are other inspections scheduled?	i. Based on annual or periodic schedules	i. Based on annual or periodic schedules	i. Based on annual or periodic schedules	

		i. At least annually updated or	i. At least annually updated or verified
17i: What are the inputs to	i. At least annually updated or verified static	verified static maps of equipment	static maps of equipment and
scheduling other inspections?	maps of equipment and environment	and environment	environment

Capability maturity level based			Planned state by end of cycle: 1
on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	(projected)
	Responses to su	rvey questions	
	Survey questions and the utility	's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
18a: What items are captured within inspection procedures and checklists?	iii. Patrol, detailed, enhanced, and other inspection procedures and checklists include all items required by statute and regulations, and includes lines and equipment typically responsible for ignitions and near misses	iii. Patrol, detailed, enhanced, and other inspection procedures and checklists include all items required by statute and regulations, and includes lines and equipment typically responsible for ignitions and near misses	iii. Patrol, detailed, enhanced, and other inspection procedures and checklists include all items required by statute and regulations, and includes lines and equipment typically responsible for ignitions and near misses
18b: How are procedures and checklists determined?	i. Based on statute and regulatory guidelines only	i. Based on statute and regulatory guidelines only	i. Based on statute and regulatory guidelines only
18c: At what level of granularity are the depth of checklists, training, and procedures customized?	v. At the asset level	v. At the asset level	v. At the asset level

Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 2 By end of year 1 (current): 2		Planned state by end of cycle: 2 (projected)		
Responses to survey questions Survey questions and the utility's responses are shown below					
Question     Start of cycle     By end of year 1 (current)     Planned state by end of cycle					
19a: What level are electrical lines and equipment maintained at?	<ul> <li>iii. Electrical lines and equipment maintained as required by regulation, and additional maintenance done in areas of grid at highest wildfire risk based on detailed risk mapping</li> </ul>	iii. Electrical lines and equipment maintained as required by regulation, and additional maintenance done in areas of grid at highest wildfire risk based on detailed risk mapping	<ul> <li>iii. Electrical lines and equipment</li> <li>maintained as required by regulation,</li> <li>and additional maintenance done in</li> <li>areas of grid at highest wildfire risk</li> <li>based on detailed risk mapping</li> </ul>		
19b: How are service intervals set?	iv. None of the above	iv. None of the above	iv. None of the above		
19c: What do maintenance and repair procedures take into account?	iii. None of the above	iii. None of the above	iii. None of the above		

	Capability 20. QA/QC for asset management				
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 2	By end of year 1 (current): 2	Planned state by end of cycle: 2 (projected)		
Responses to survey questions					
Survey questions and the utility's responses are shown below           Question         Start of cycle         By end of year 1 (current)         Planned state by end of cycle					
		ii. Through an established and	ii. Through an established and		
	ii. Through an established and functioning	functioning audit process to	functioning audit process to manage		
20a: How is contractor activity	audit process to manage and confirm work	manage and confirm work	and confirm work completed by		
audited?	completed by subcontractors	completed by subcontractors	subcontractors		
20b: Do contractors follow the					
same processes and standards					
as utility's own employees?	ii. Yes	ii. Yes	ii. Yes		
20c: How frequently is QA/QC					
information used to identify					
deficiencies in quality of work					
performance and inspections					
performance?	iv. Regularly	iv. Regularly	iv. Regularly		
		iii. QA/QC information is used to	iv. QA/QC information is used to identify		
20d: How are work and	<li>iii. QA/QC information is used to identify</li>	identify systemic deficiencies in	systemic deficiencies in quality of work		
inspections that do not meet	systemic deficiencies in quality of work and	quality of work and inspections,	and inspections, grade individuals, and		
utility-prescribed standards	inspections, and recommend training based	and recommend training based	recommend specific pre-made and		
remediated?	on weaknesses	on weaknesses	tested training based on weaknesses		
20e: Are workforce					
management software tools					
used to manage and confirm					
work completed by					
subcontractors?	ii. Yes	ii. Yes	ii. Yes		

Attachments-22

# Category E. Vegetation management and inspections

		Avg current maturity: 0.3	Avg projected cycle end maturity: 0.3
	Capability 21. Vegetation invent	ory and condition assessments	r
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su Survey questions and the utility	rvey questions	-
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
21a: What information is captured in the inventory?	<ul> <li>There is no vegetation inventory sufficient to determine vegetation clearances across the grid at the time of the last inspection</li> </ul>	i. There is no vegetation inventory sufficient to determine vegetation clearances across the grid at the time of the last inspection	i. There is no vegetation inventory sufficient to determine vegetation clearances across the grid at the time of the last inspection
21b: How frequently is inventory updated?	i. Never	i. Never	i. Never
21c: Are inspections independently verified by third party experts?	i. No	i. No	i. No
21d: How granular is the inventory?	iv. Asset-based	iv. Asset-based	iv. Asset-based

Capability 22. Vegetation inspection cycle					
Capability maturity level basedon Maturity Rubric (0 - 4)Start of cycle: 1		Planned state by end of cycle: 1 (projected)			
<b>Responses to survey questions</b> Survey questions and the utility's responses are shown below					
Start of cycle	By end of year 1 (current)	Planned state by end of cycle			
ii. Consistent with minimum regulatory requirements	ii. Consistent with minimum regulatory requirements	ii. Consistent with minimum regulatory requirements			
i. Based on annual or periodic schedules	i. Based on annual or periodic schedules	i. Based on annual or periodic schedules			
i. At least annually-updated static maps of vegetation and environment	i. At least annually-updated static maps of vegetation and environment	i. At least annually-updated static maps of vegetation and environment			
	Start of cycle: 1 Responses to su Survey questions and the utility Start of cycle ii. Consistent with minimum regulatory requirements i. Based on annual or periodic schedules	Start of cycle: 1       By end of year 1 (current): 1         Responses to survey questions         Survey questions and the utility's responses are shown below         Start of cycle       By end of year 1 (current)         ii. Consistent with minimum regulatory requirements       ii. Consistent with minimum regulatory regulatory requirements         i. Based on annual or periodic schedules       i. Based on annual or periodic schedules         i. At least annually-updated static maps of       i. At least annually-updated static maps of vegetation and			

Capability maturity level based on Maturity Rubric (0 - 4) S	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1			
			Planned state by end of cycle: 1 (projected)			
	<b>Responses to survey questions</b> Survey questions and the utility's responses are shown below					
Question S	Start of cycle	By end of year 1 (current)	Planned state by end of cycle			
within inspection procedures in	ii. Patrol, detailed, enhanced, and other inspection procedures and checklists include all items required by statute and regulations	ii. Patrol, detailed, enhanced, and other inspection procedures and checklists include all items required by statute and regulations	ii. Patrol, detailed, enhanced, and other inspection procedures and checklists include all items required by statute and regulations			
•	i. Based on statute and regulatory guidelines only	i. Based on statute and regulatory guidelines only	i. Based on statute and regulatory guidelines only			
23c: At what level of granularity are the depth of checklists, training, and procedures customized?	v. At the asset level	v. At the asset level	v. At the asset level			

Capability 24. Vegetation grow-in mitigation					
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0			
	Responses to survey questions Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle		
24a: How does utility clearance around lines and equipment perform relative to expected standards?	<ul> <li>iii. Utility exceeds minimum statutory and regulatory clearances around all lines and equipment</li> </ul>	<ul> <li>iii. Utility exceeds minimum</li> <li>statutory and regulatory</li> <li>clearances around all lines and</li> <li>equipment</li> </ul>	iii. Utility exceeds minimum statutory and regulatory clearances around all lines and equipment		
24b: Does utility meet or exceed minimum statutory or regulatory clearances during all seasons?	ii. Yes	ii. Yes	ii. Yes		
24c: What modeling is used to guide clearances around lines and equipment?	iii. None of the above	iii. None of the above	iii. None of the above		
24d: What biological modeling is used to guide clearance around lines and equipment	iii. None of the above	iii. None of the above	iii. None of the above		
24e: Are community organizations engaged in setting local clearances and protocols?	i. No	i. No	i. No		
24f: Does the utility remove vegetation waste along its right of way across the entire grid?	i. No	i. No	i. No		
24g: How long after cutting vegetation does the utility remove vegetation waste along right of way?	i. Not at all	i. Not at all	i. Not at all		

24h: Does the utility work with local landowners to provide a cost-effective use for cutting vegetation?	i. No	i. No	i. No
24i: Does the utility work with partners to identify new cost- effective uses for vegetation, taking into consideration environmental impacts and			
emissions of vegetation waste?	i. No	i. No	i. No

Capability 25. Vegetation fall-in mitigation				
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0		
Responses to survey questions Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
25a: Does the utility have a process for treating vegetation outside of right of ways?	i. Utility does not remove vegetation outside of right of way	i. Utility does not remove vegetation outside of right of way	i. Utility does not remove vegetation outside of right of way	
25b: How is potential vegetation that may pose a threat identified?	<ul> <li>i. No specific process in place to systematically identify trees likely to pose a risk</li> </ul>	<ul> <li>No specific process in place to systematically identify trees likely to pose a risk</li> </ul>	<ul> <li>No specific process in place to systematically identify trees likely to pose a risk</li> </ul>	
25c: Is vegetation removed with cooperation from the community?	i. No	i. No	i. No	
25d: Does the utility remove vegetation waste outside its right of way across the entire grid?	i. No	i. No	i. No	
25e: How long after cutting vegetation does the utility remove vegetation waste				
outside its right of way?	i. Not at all	i. Not at all	i. Not at all	

25f: Does the utility work with local landowners to provide a cost-effective use for cutting vegetation?	i. No	i. No	i. No
25g: Does the utility work with partners to identify new cost- effective uses for vegetation, taking into consideration environmental impacts and			
emissions of vegetation waste?	i. No	i. No	i. No

Capability 26. QA/QC for vegetation management				
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0		
	Responses to su			
	Survey questions and the utility	's responses are shown below		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
26a: How is contractor and employee activity audited?	i. Lack of controls for auditing work completed, including inspections, for employees or subcontractors	<ul> <li>i. Lack of controls for auditing work completed, including inspections, for employees or subcontractors</li> </ul>	i. Lack of controls for auditing work completed, including inspections, for employees or subcontractors	
26b: Do contractors follow the same processes and standards as utility's own employees?	ii. Yes	ii. Yes	ii. Yes	
26c: How frequently is QA/QC information used to identify deficiencies in quality of work performance and inspections performance?	i. Never	i. Never	i. Never	
26d: How is work and inspections that do not meet	<ul> <li>ii. QA/QC information is used to identify systemic deficiencies in quality of work and inspections</li> </ul>	<ul> <li>ii. QA/QC information is used to identify systemic deficiencies in quality of work and inspections</li> </ul>	<ul> <li>ii. QA/QC information is used to identify systemic deficiencies in quality of work and inspections</li> </ul>	

Attachments-28

utility-prescribed standards remediated?				
26e: Are workforce management software tools used to manage and confirm work completed by subcontractors?	i. No	i. No	i. No	

## Category F. Grid operations and protocols

	Avg cycle start maturity: 1.2	Avg current maturity: 1.2	Avg projected cycle end maturity: 1.7
	Capability 27. Protective equ		Avg projected cycle chu matarity. 1.7
Capability maturity level based	Start of puploy 0	Du and of user 1 (surrout): 0	
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	<b>Responses to su</b> Survey questions and the utility		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
27a: How are grid elements adjusted during high threat weather conditions?	i. Utility does not make changes to adjustable equipment in response to high wildfire threat conditions	<ul> <li>i. Utility does not make changes</li> <li>to adjustable equipment in</li> <li>response to high wildfire threat</li> <li>conditions</li> </ul>	<ul> <li>i. Utility does not make changes to adjustable equipment in response to high wildfire threat conditions</li> </ul>
27b: Is there an automated process for adjusting sensitivity of grid elements and evaluating effectiveness?	i. No automated process	i. No automated process	i. No automated process
27c: Is there a predetermined protocol driven by fire conditions for adjusting			
sensitivity of grid elements?	i. No	i. No	i. No

Capability 28. Incorporating ignition risk factors in grid control					
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)		
	<b>Responses to survey questions</b> Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle		
28a: Does the utility have a clearly explained process for determining whether to operate the grid beyond current or voltage designs?	ii. Yes	ii. Yes	ii. Yes		
28b: Does the utility have systems in place to automatically track operation history including current, loads, and voltage throughout the grid					
at the circuit level?	ii. Yes	ii. Yes	ii. Yes		
28c: Does the utility use predictive modeling to estimate the expected life and make equipment maintenance, rebuild, or replacement decisions based on grid operating history, and is that					
model reviewed?	i. Modeling is not used	i. Modeling is not used	i. Modeling is not used		
28d: When does the utility operate the grid above rated voltage and current load?	iii. Never	iii. Never	iii. Never		

Capability 29. PSPS op. model and consequence mitigation					
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)		
	<b>Responses to survey questions</b> Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle		
29a: How effective is PSPS event forecasting?	<ul> <li>ii. PSPS event generally forecasted accurately with fewer than 50% of predictions being false positives</li> </ul>	<ul> <li>ii. PSPS event generally forecasted accurately with fewer than 50% of predictions being false positives</li> </ul>	<ul> <li>ii. PSPS event generally forecasted accurately with fewer than 50% of predictions being false positives</li> </ul>		
29b: What share of customers are communicated to regarding forecasted PSPS events?	v. PSPS event are communicated to >99.9% of affected customers and 100% of medical baseline customers in advance of PSPS action	v. PSPS event are communicated to >99.9% of affected customers and 100% of medical baseline customers in advance of PSPS action	<ul> <li>v. PSPS event are communicated to</li> <li>&gt;99.9% of affected customers and 100%</li> <li>of medical baseline customers in</li> <li>advance of PSPS action</li> </ul>		
29c: During PSPS events, what percent of customers complain?	iii. Less than 0.5%	iii. Less than 0.5%	iii. Less than 0.5%		
29d: During PSPS events, does the utility's website go down?	i. No	i. No	i. No		
29e: During PSPS events, what is the average downtime per customer?	v. Less than 0.1 hours	v. Less than 0.1 hours	v. Less than 0.1 hours		
29f: Are specific resources provided to all affected customers to alleviate the impact of the power shutoff (e.g., providing backup generators, supplies, batteries,					
etc.)?	i. No	i. No	i. No		

Capability 30. Protocols for PSPS initiation			
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)
	Responses to su	rvey questions	
	Survey questions and the utility	's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
30a: Does the utility have explicit thresholds for activating a PSPS?	iii. Utility has explicit policies and explanation for the thresholds above which PSPS is activated, but maintains grid in sufficiently low risk condition to not require any PSPS activity, though may de-energize specific circuits upon detection of damaged condition of electrical lines and equipment, or contact with foreign objects	iii. Utility has explicit policies and explanation for the thresholds above which PSPS is activated, but maintains grid in sufficiently low risk condition to not require any PSPS activity, though may de- energize specific circuits upon detection of damaged condition of electrical lines and equipment, or contact with foreign objects	iii. Utility has explicit policies and explanation for the thresholds above which PSPS is activated, but maintains grid in sufficiently low risk condition to not require any PSPS activity, though may de-energize specific circuits upon detection of damaged condition of electrical lines and equipment, or contact with foreign objects
30b: Which of the following does the utility take into account when making PSPS decisions? Select all that apply	i. SME opinion		i. SME opinion
30c: Under which circumstances does the utility de-energize circuits? Select all that apply.	i. Upon detection of damaged conditions of electric equipment ii. When circuit presents a safety risk to suppression or other personnel iii. When equipment has come into contact with foreign objects posing ignition risk	i. Upon detection of damaged conditions of electric equipment ii. When circuit presents a safety risk to suppression or other personnel iii. When equipment has come into contact with foreign objects posing ignition risk	i. Upon detection of damaged conditions of electric equipment ii. When circuit presents a safety risk to suppression or other personnel iii. When equipment has come into contact with foreign objects posing ignition risk

coming year? will not be disrupted disrupted disrupted disrupted	grid, with what probability does the utility expect any large scale PSPS events affecting more than 10,000 people to occur in the	i. Less than 5 % - Grid is in sufficiently low risk condition that PSPS events will not be required, and the only circuits which may require de-energization have sufficient redundancy that energy supply to customers will not be disrupted	i. Less than 5 % - Grid is in sufficiently low risk condition that PSPS events will not be required, and the only circuits which may require de-energization have sufficient redundancy that energy supply to customers will not be disrupted	i. Less than 5 % - Grid is in sufficiently low risk condition that PSPS events will not be required, and the only circuits which may require de-energization have sufficient redundancy that energy supply to customers will not be disrupted
--	--	--	--	---

Capability 31. Protocols for PSPS re-energization				
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 4	By end of year 1 (current): 4	Planned state by end of cycle: 4 (projected)	
<b>Responses to survey questions</b> Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
31a: Is there a process for inspecting de-energized sections of the grid prior to re- energization?	iii. Existing process for accurately inspecting de-energized sections of the grid prior to re- energization, augmented with sensors and aerial tools	iii. Existing process for accurately inspecting de-energized sections of the grid prior to re- energization, augmented with sensors and aerial tools	iii. Existing process for accurately inspecting de-energized sections of the grid prior to re-energization, augmented with sensors and aerial tools	
31b: How automated is the process for inspecting de- energized sections of the grid prior to re-energization?	iv. Primarily automated, minimal manual inputs	iv. Primarily automated, minimal manual inputs	iv. Primarily automated, minimal manual inputs	

to below your de-energization threshold? v. Wit			
	thin 8 hours	v. Within 8 hours	v. Within 8 hours
understanding of probability of under ignitions after PSPS events does energi	ility has accurate quantitative rstanding of ignition risk following re- gization, by asset, validated by historical and near misses	<ul> <li>iii. Utility has accurate</li> <li>quantitative understanding of</li> <li>ignition risk following re-</li> <li>energization, by asset, validated</li> <li>by historical data and near misses</li> </ul>	iii. Utility has accurate quantitative understanding of ignition risk following re-energization, by asset, validated by historical data and near misses
		by historical data and rical misses	

Capability 32. Ignition prevention and suppression				
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	Planned state by end of cycle: 3 (projected)	
Responses to survey questions Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
32a: Does the utility have defined policies around the role of workers in suppressing ignitions?	i. Utility has no policies governing what crews' roles are in suppressing ignitions	i. Utility has no policies governing what crews' roles are in suppressing ignitions	<ul> <li>iii. Utilities have explicit policies about the role of crews, including contractors and subcontractors, at the site of ignition</li> </ul>	
32b: What training and tools are provided to workers in the field?	iv. All criteria in option (iii) met; In addition, communication tools function without cell reception and training by suppression professionals is provided	iv. All criteria in option (iii) met; In addition, communication tools function without cell reception and training by suppression professionals is provided	iv. All criteria in option (iii) met; In addition, communication tools function without cell reception and training by suppression professionals is provided	

32c: In the events where workers have encountered an ignition, have any Cal/OSHA reported injuries or fatalities occurred in in the last year?	i. No	i. No	i. No
32d: Does the utility provide training to other workers at other utilities and outside the utility industry on best practices to minimize, report and suppress ignitions?	i. No	i. No	i. No
	-	-	-

## Category G. Data governance

	Avg cycle start maturity: 0.5	Avg current maturity: 0.5	Avg projected cycle end maturity: 1.3	
	Capability 33. Data col	lection and curation		
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	Planned state by end of cycle: 2 (projected)	
<b>Responses to survey questions</b> Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
33a: Does the utility have a centralized database of situational, operational, and risk data?	i. No	i. No	ii. Yes	
33b: Is the utility able to use advanced analytics on its centralized database of situational, operational, and risk data to make operational and			iii. Yes, for both short term and long-	
investment decisions?	i. No	i. No	term decision making	
33c: Does the utility collect data from all sensored portions of electric lines, equipment,				
weather stations, etc.? 33d: Is the utility's database of situational, operational, and risk data able to ingest and share data using real-time API protocols with a wide variety of	ii. Yes	ii. Yes	ii. Yes	
stakeholders?	i. No	i. No	i. No	

33e: Does the utility identify highest priority additional data sources to improve decision			
making?	i. No	i. No	i. No
33f: Does the utility share best			
practices for database			
management and use with other			
utilities in California and			
beyond?	i. No	i. No	i. No

Capability 34. Data transparency and analytics				
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	Planned state by end of cycle: 1 (projected)	
Responses to survey questions				
	Survey questions and the utility	's responses are shown below		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
34a: Is there a single document cataloguing all fire-related data and algorithms, analyses, and data processes?	i. No	i. No	ii. Yes	
34b: Is there an explanation of the sources, cleaning processes, and assumptions made in the single document catalog?	i. No	i. No	ii. Yes	
34c: Are all analyses, algorithms, and data processing explained and documented?	i. Analyses, algorithms, and data processing are not documented	i. Analyses, algorithms, and data processing are not documented	ii. Analyses, algorithms, and data processing are documented	
34d: Is there a system for sharing data in real time across multiple levels of permissions?	i. No system capable of sharing data in real time across multiple levels of permissions	<ul> <li>No system capable of sharing data in real time across multiple levels of permissions</li> </ul>	<ul> <li>No system capable of sharing data in real time across multiple levels of permissions</li> </ul>	

34e: Are the most relevant			
wildfire related data algorithms	iii. Yes, disclosed publicly in WMP upon	iii. Yes, disclosed publicly in WMP	iii. Yes, disclosed publicly in WMP upon
disclosed?	request	upon request	request

	Capak	pility 35. Near-miss tracking	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)
	•	onses to survey questions Ind the utility's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
35a: Does the utility track near miss data for all near misses with wildfire ignition potential?	ii. Yes	ii. Yes	ii. Yes
35b: Based on near miss data captured, is the utility able to simulate wildfire potential given an ignition based on event characteristics, fuel loads, and moisture?			
moisture? 35c: Does the utility capture data related to the specific mode of failure when capturing near-miss data?	i. No ii. Yes	i. No ii. Yes	i. No ii. Yes
35d: Is the utility able to predict the probability of a near miss in causing an ignition based on a set of event characteristics?	i. No	i. No	i. No
35e: Does the utility use data from near misses to change grid operation protocols in real time?	i. No	i. No	i. No

	with research community	
Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)
-		
Start of cycle	By end of year 1 (current)	Planned state by end of cycle
ii. Utility makes required disclosures, but does not share data beyond what is required	ii. Utility makes required disclosures, but does not share data beyond what is required	ii. Utility makes required disclosures, but does not share data beyond what is required
i. Utility does not participate in collaborative research	i. Utility does not participate in collaborative research	i. Utility does not participate in collaborative research
iii. None of the above	iii. None of the above	iii. None of the above
i. No	i. No	i. No
; ; ;	Responses to sur Survey questions and the utility Start of cycle ii. Utility makes required disclosures, but does not share data beyond what is required i. Utility does not participate in collaborative research iii. None of the above	Responses to survey questions         Survey questions and the utility's responses are shown below         Start of cycle       By end of year 1 (current)         ii. Utility makes required disclosures, but disclosures, but does not share data beyond what is required       ii. Utility makes required disclosures, but does not share data beyond what is required         i. Utility does not participate in collaborative research       ii. Utility does not participate in collaborative research         iii. None of the above       iii. None of the above

### Category H. Resource allocation methodology

	Avg cycle start maturity: 0	Avg current maturity: 0	Avg projected cycle end maturity: 0
	Capability 37. Scenario analysi	is across different risk levels	
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su		
	Survey questions and the utility		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
37a: For what risk scenarios is the utility able to provide projected cost and total risk reduction potential?	<ul> <li>Utility does not project proposed initiatives or costs across different levels of risk scenarios</li> </ul>	i. Utility does not project proposed initiatives or costs across different levels of risk scenarios	i. Utility does not project proposed initiatives or costs across different levels of risk scenarios
37b: For what level of granularity is the utility able to provide projections for each scenario?	0		0
37c: Does the utility include a long term (e.g., 6-10 year) risk estimate taking into account macro factors (climate change, etc.) as well as planned risk reduction initiatives in its scenarios?	i. No	i. No	i. No
37d: Does the utility provide an estimate of impact on reliability factors in its scenarios?	ii. Yes	ii. Yes	ii. Yes

Capability maturity level based			
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses	to survey questions	
	Survey questions and the u	tility's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
38a: Does the utility present accurate qualitative rankings for its initiatives by risk spend			
efficiency?	i. No	i. No	i. No
38b: What initiatives are captured in the ranking of risk spend efficiency?	iv. None of the above	iv. None of the above	iv. None of the above
38c: Does the utility include figures for present value cost and project risk reduction impact of each initiative, clearly documenting all assumptions (e.g. useful life, discount rate,			
etc.)?	i. No	i. No	i. No
38d: Does the utility provide an explanation of their investment in each particular initiative?	ii. Yes, including the expected overall reduction in risk	ii. Yes, including the expected overall reduction in risk	ii. Yes, including the expected overall reduction in risk
38e: At what level of granularity is the utility able to provide risk efficiency figures?		0	0

Ca	pability 39. Process for determining risk spend	efficiency of vegetation managemen	t initiatives	
Capability maturity level based				
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0		
	Responses to su	rvey questions		
	Survey questions and the utility	's responses are shown below		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
	i. Utility has no clear understanding of the	<ul> <li>Utility has no clear understanding of the relative risk spend efficiency of various</li> </ul>	i. Utility has no clear understanding of	F
39a: How accurate of a risk spend efficiency calculation can the utility provide?	relative risk spend efficiency of various clearances and types of vegetation management initiatives	clearances and types of vegetation management initiatives	the relative risk spend efficiency of various clearances and types of vegetation management initiatives	
39b: At what level can estimates be prepared?	0	0		0
39c: How frequently are estimates updated?	i. Never	i. Never	i. Never	
39d: What vegetation management initiatives does the utility include within its				
evaluation? 39e: Can the utility evaluate risk reduction synergies from combination of various	i. None	i. None	i. None	
initiatives?	i. No	i. No	i. No	

	Capability 40. Process for determining risk spe	nd efficiency of system hardening in	itiatives
Capability maturity level based			
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to su	rvey questions	
	Survey questions and the utility	's responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
40a: How accurate of a risk spend efficiency calculation can the utility provide?	<ul> <li>ii. Utility has accurate relative understanding of cost and effectiveness to produce a reliable risk spend efficiency estimate</li> </ul>	ii. Utility has accurate relative understanding of cost and effectiveness to produce a reliable risk spend efficiency estimate	<ul> <li>ii. Utility has accurate relative</li> <li>understanding of cost and effectiveness</li> <li>to produce a reliable risk spend</li> <li>efficiency estimate</li> </ul>
40b: At what level can estimates be prepared?	0	0	0
40c: How frequently are estimates updated?	ii. Less frequently than annually	ii. Less frequently than annually	iii. Annually or more frequently
40d: What grid hardening initiatives are included in the utility risk spend efficiency			
analysis? 40e: Can the utility evaluate risk reduction effects from the combination of various	i. None	i. None	i. None
initiatives?	ii. Yes	ii. Yes	ii. Yes

	Capability 41. Portfolio-wide init	iative allocation methodology	
Capability maturity level based			
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	
	Responses to sur	vey questions	
	Survey questions and the utility	s responses are shown below	
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
41a: To what extent does the utility allocate capital to initiatives based on risk-spend efficiency (RSE)?	i. Utility does not base capital allocation on RSE	i. Utility does not base capital allocation on RSE	i. Utility does not base capital allocation on RSE
41b: What information does the utility take into account when generating RSE estimates?	ii. Specific information by initiative, including state of equipment and location where initiative will be implemented	<ul> <li>ii. Specific information by</li> <li>initiative, including state of</li> <li>equipment and location where</li> <li>initiative will be implemented</li> </ul>	ii. Specific information by initiative, including state of equipment and location where initiative will be implemented
41c: How does the utility verify RSE estimates? 41d: Does the utility take into consideration impact on safety, reliability, and other priorities when making spending	i. Utility does not verify RSE estimates	i. Utility does not verify RSE estimates	i. Utility does not verify RSE estimates
decisions?	ii. Yes	ii. Yes	ii. Yes

	Capability 42. Portfolio-wide in	novation in new wildfire initiatives		
Capability maturity level based				
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0		
	Responses to	survey questions		
	Survey questions and the util	ity's responses are shown below		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
42a: How does the utility develop and evaluate the efficacy of new wildfire				
initiatives?	i. No program in place	i. No program in place	i. No program in place	
42b: How does the utility develop and evaluate the risk spend efficiency of new wildfire				
initiatives?	i. No program in place	i. No program in place	i. No program in place	
42c: At what level of granularity does the utility measure the efficacy of new wildfire initiatives?		0	0	0
42d: Are the reviews of innovative initiatives audited by independent parties?	i. No	i. No	i. No	
42e: Does the utility share the findings of its evaluation of innovative initiatives with other utilities, academia, and the				
general public?	i. No	i. No	i. No	
utilities, academia, and the general public?	i. No	i. No	i. No	

## Category I. Emergency planning and preparedness

	Avg cycle start maturity: 1.2	Avg current maturity: 1.2	Avg projected cycle end maturity: 2.2
	Capability 43. Wildfire plan integrated	with overall disaster/ emergency pla	n
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	Planned state by end of cycle: 3 (projected)
	<b>Responses to su</b> Survey questions and the utility		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle
43a: Is the wildfire plan integrated with overall disaster and emergency plans?	iii. Wildfire plan is an integrated component of overall plan	iii. Wildfire plan is an integrated component of overall plan	iii. Wildfire plan is an integrated component of overall plan
43b: Does the utility run drills to audit the viability and execution of its wildfire plans?	i. No	i. No	ii. Yes
43c: Is the impact of confounding events or multiple simultaneous disasters considered in the planning			
process?	i. No	i. No	ii. Yes
43d: Is the plan integrated with disaster and emergency preparedness plans of other relevant stakeholders (e.g., CAL FIRE, Fire Safe Councils, etc.)?	i. No	i. No	ii. Yes
43e: Does the utility take a leading role in planning, coordinating, and integrating plans across stakeholders?	i. No	i. No	i. No

Capability 44. Plan to restore service after wildfire related outage								
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 3	By end of year 1 (current): 3	Planned state by end of cycle: 3 (projected)					
	Responses to survey questions Survey questions and the utility's responses are shown below							
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle					
44a: Are there detailed and actionable procedures in place to restore service after a wildfire related outage?	ii. Yes	ii. Yes	ii. Yes					
44b: Are employee and subcontractor crews trained in, and aware of, plans?	ii. Yes	ii. Yes	ii. Yes					
44c: To what level are procedures to restore service after a wildfire-related outage customized?	0	0		0				
44d: Is the customized procedure to restore service based on topography, vegetation, and community needs?	i. No	i. No	i. No					
44e: Is there an inventory of high risk spend efficiency resources available for repairs?	ii. Yes	ii. Yes	ii. Yes					
44f: Is the wildfire plan integrated with overall disaster and emergency plans?	iii. Wildfire plan is an integrated component of overall plan	iii. Wildfire plan is an integrated component of overall plan	iii. Wildfire plan is an integrated component of overall plan					
integrated with overall disaster			-	-				

	Capability 45. Emergency community engagement during and after wildfire						
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 1	By end of year 1 (current): 1	Planned state by end of cycle: 1 (projected)				
	Responses to survey questions Survey questions and the utility's responses are shown below						
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle				
45a: Does the utility provide clear and substantially complete communication of available information relevant to affected customers?	ii. Yes	ii. Yes	ii. Yes				
45b: What percent of affected	11. 103	11. 103	11. 105				
customers receive complete		v. >99.9% of medical baseline					
details of available information?	v. >99.9% of medical baseline customers	customers	v. >99.9% of medical baseline customers				
45c: What percent of affected medical baseline customers receive complete details of available information?	v. >99.9% of medical baseline customers	v. >99.9% of medical baseline customers	v. >99.9% of medical baseline customers				
45d: How does the utility assist where helpful with communication of information related to power outages to customers?	iii. None of the above	iii. None of the above	iii. None of the above				
45e: How does the utility with engage other emergency management agencies during emergency situations?	ii. Utility engages with other agencies in an ad hoc manner	ii. Utility engages with other agencies in an ad hoc manner	iii. Utility has detailed and actionable established protocols for engaging with emergency management organizations				
45f: Does the utility communicate and coordinate resources to communities during emergencies (e.g.,	i. No	i. No	i. No				

Attachments-49

shelters, supplies, transportation etc.)?		

Capability 46. Protocols in place to learn from wildfire events						
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 2	By end of year 1 (current): 2	Planned state by end of cycle: 4 (projected)			
	Responses to survey questions					
	Survey questions and the utilit	y's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle			
46a: Is there a protocol in place						
to record the outcome of						
emergency events and to clearly						
and actionably document						
learnings and potential process						
improvements?	ii. Yes	ii. Yes	ii. Yes			
46b: Is there a defined process						
and staff responsible for						
incorporating learnings into						
emergency plan?	ii. Yes	ii. Yes	ii. Yes			
46c: Once updated based on						
learnings and improvements, is						
the updated plan tested using						
"dry runs" to confirm its						
effectiveness?	i. No	i. No	ii. Yes			

46d: Is there a defined process to solicit input from a variety of other stakeholders and incorporate learnings from other stakeholders into the			
emergency plan?	i. No	i. No	ii. Yes

Capability 47. Processes for continuous improvement after wildfire and PSPS				
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0		
		sponses to survey questions and the utility's responses are shown below		
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
47a: Does the utility conduct an evaluation or debrief process after a wildfire?	i. No	i. No	i. No	
47b: Does the utility conduct a customer survey and utilize partners to disseminate requests for stakeholder				
engagement?	i. No	i. No	i. No	
47c: In what other activities does the utility engage?	i. None	i. None	i. None	
47d: Does the utility share with partners findings about what can be improved?	i. No	i. No	ii. Yes	
47e: Are feedback and recommendations on potential improvements made public?	i. No	i. No	ii. Yes	

Attachments-51

47f: Does the utility conduct proactive outreach to local			
agencies and organizations to solicit additional feedback on			
what can be improved?	i. No	i. No	ii. Yes
47g: Does the utility have a clear plan for post-event listening and incorporating lessons learned			
from all stakeholders?	i. No	i. No	ii. Yes
47h: Does the utility track the implementation of recommendations and report			
upon their impact?	i. No	i. No	ii. Yes
47i: Does the utility have a process to conduct reviews after			
wildfires in other the territory of other utilities and states to			
identify and address areas of			
improvement?	i. No	i. No	ii. Yes

# Category J. Stakeholder cooperation and community engagement

	Avg cycle start maturity: 0.4	Avg current maturity: 0.4	Avg projected cycle end maturity: 1.8			
	Capability 48. Cooperation and best practice sharing with other utilities					
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	Planned state by end of cycle: 4 (projected)			
	Responses to sur					
	Survey questions and the utility	's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle			
48a: Does the utility actively work to identify best practices from other utilities through a clearly defined operational process?	i. No	i. No	ii. Yes, from other California utilities			
48b: Does the utility successfully adopt and implement best practices identified from other utilities?	ii. Yes	ii. Yes	ii. Yes			
48c: Does the utility seek to share best practices and lessons learned in a consistent format?	i. No	i. No	ii. Yes			
48d: Does the utility share best practices and lessons via a consistent and predictable set of venues/media?	i. No	i. No	ii. Yes			
48e: Does the utility participate in annual benchmarking exercises with other utilities to find areas for improvement?	i. No	i. No	ii. Yes			

48f: Has the utility imple	mented			
a defined process for tes	ting			
lessons learned from oth	er			
utilities to ensure local				
applicability?	i. No	i. No	ii. Yes	

Capability 49. Engagement with communities on utility wildfire mitigation initiatives					
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0	Planned state by end of cycle: 3 (projected)		
Responses to survey questions Survey questions and the utility's responses are shown below					
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle		
49a: Does the utility have a clear and actionable plan to develop or maintain a collaborative relationship with local communities?	i. No	i. No	ii. Yes		
49b: Are there communities in HFTD areas where meaningful resistance is expected in response to efforts to mitigate fire risk (e.g. vegetation	1. 100	1. 110			
clearance)?	i. No	i. No	i. No		
49c: What percent of landowners are non-compliant with utility initiatives (e.g.,					
vegetation management)? 49d: What percent of landowners complain about utility initiatives (e.g., vegetation	v. Less than 0.5%	v. Less than 0.5%	v. Less than 0.5%		
management)?	iv. Less than 1 %	iv. Less than 1 %	iv. Less than 1 %		

49e: Does the utility have a demonstratively cooperative relationship with communities containing >90% of the population in HFTD areas (e.g. by being recognized by other agencies as having a cooperative relationship with those			
communities in HFTD areas)?	i. No	i. No	i. No
49f: Does utility have records of			
landowners throughout			
communities containing >90% of			
the population in HFTD areas			
reaching out to notify of risks,			
dangers or issues in the past			
year?	i. No	i. No	i. No

Capability 50. Engagement with LEP and AFN populations					
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0			
	Responses to survey questions Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle		
50a: Can the utility provide a plan to partner with organizations representing Limited English Proficiency (LEP) and Access & Functional Needs (AFN) communities?	i. No	i. No	i. No		

50b: Can the utility outline how			
these partnerships create			
pathways for implementing			
suggested activities to address			
the needs of these			
communities?	i. No	i. No	i. No
50c: Can the utility point to clear			
examples of how those			
relationships have driven the			
utility's ability to interact with			
and prepare LEP & AFN			
communities for wildfire			
mitigation activities?	i. No	i. No	i. No
50d: Does the utility have a			
-			
specific annually-updated action			
specific annually-updated action plan further reduce wildfire and			
plan further reduce wildfire and			
	i. No	i. No	i. No
plan further reduce wildfire and PSPS risk to LEP & AFN	i. No	i. No	i. No
plan further reduce wildfire and PSPS risk to LEP & AFN	i. No	i. No	i. No
plan further reduce wildfire and PSPS risk to LEP & AFN	i. No	i. No	i. No
plan further reduce wildfire and PSPS risk to LEP & AFN	i. No	i. No	i. No
plan further reduce wildfire and PSPS risk to LEP & AFN	i. No	i. No	i. No

Capability 51. Collaboration with emergency response agencies				
Capability maturity level based on Maturity Rubric (0 - 4)	Start of cycle: 2	By end of year 1 (current): 2	Planned state by end of cycle: 2 (projected)	
<b>Responses to survey questions</b> Survey questions and the utility's responses are shown below				
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle	
51a: What is the cooperative model between the utility and suppression agencies?	iii. Utility cooperates with suppression agencies by working cooperatively with them to detect ignitions, in addition to notifying them of ignitions as needed	<ul> <li>iii. Utility cooperates with</li> <li>suppression agencies by working</li> <li>cooperatively with them to detect</li> <li>ignitions, in addition to notifying</li> <li>them of ignitions as needed</li> </ul>	iii. Utility cooperates with suppression agencies by working cooperatively with them to detect ignitions, in addition to notifying them of ignitions as needed	

51c: Does the utility accurately predict and communicate the forecasted fire propagation path			
using available analytics resources and weather data? i. No	0	i. No	i. No
51d: Does the utility communicate fire paths to the community as requested? i. No			i. No
51e: Does the utility work to assist suppression crews logistically, where possible? ii. Ye	 'es	ii. Yes	ii. Yes

Capability 52. Collaboration on wildfire mitigation planning with stakeholders							
Capability maturity level based							
on Maturity Rubric (0 - 4)	Start of cycle: 0	By end of year 1 (current): 0					
Responses to survey questions							
Survey questions and the utility's responses are shown below							
Question	Start of cycle	By end of year 1 (current)	Planned state by end of cycle				
52a: Where does the utility							
conduct substantial fuel		i. Utility does not conduct fuel	i. Utility does not conduct fuel				
management?	i. Utility does not conduct fuel management	management	management				
52b: Does the utility engage	i. Utility does not coordinate with broader	i. Utility does not coordinate with	i. Utility does not coordinate with				
with other stakeholders as part of its fuel management efforts?	fuel management efforts by other stakeholders	broader fuel management efforts by other stakeholders	broader fuel management efforts by other stakeholders				

52d: Does the utility fund local groups (e.g., fire safe councils) to support fuel management? i. No i. No i. No	52c: Does the utility cultivate a native vegetative ecosystem across territory that is consistent with lower fire risk?	i. No	i. No	i. No	
to support fuel management? i. No i. No i. No	groups (e.g., fire safe councils)				
	to support fuel management?	i. No	i. No	i. No	

#### **11.1.4.** TBC: Numerical maturity summary

Please reference the Guidance Resolution for the Maturity Rubric and for necessary context to interpret the levels shown below. All levels are based solely on the Maturity Rubric and on TBC's responses to the Utility Wildfire Mitigation Maturity Survey ("Survey").

**Start:** Score reported in February 2020; **Current:** Score reported in February 2021; **End:** Score reported in February 2021 projected for February 2023



Category	Capability 1	Capability 2	Capability 3	Capability 4	Capability 5	Capability 6
A. Risk Assessment and Mapping	1. Climate scenario modeling	2. Ignition risk estimation	3. Estimation of wildfire consequences for communities	4. Estimation of wildfire and PSPS risk-reduction impact	5. Risk maps and simulation algorithms	
Sta	Start: 1 Current: 1 End:	Start: 0 Current: 0 End: 0	Start: 0 Current: 0 End: 0	Start: 1 Current: 1 End: 3	Start: 0 Current: 0 End: 3	
B. Situational Awareness and Forecasting	6. Weather variables collecte	d 7. Weather data resolution	8. Weather forecasting ability	9. External sources used in weather forecasting	10. Wildfire detection processes and capabilities	
	Start: 0 Current: 0 End:	O Start: 0 Current: 0 End: 0	Start: 0 Current: 0 End: 0	Start: 1 Current: 1 End: 1	Start: 1 Current: 1 End: 1	
C. Grid design and system hardening	11. Approach to prioritizing initiatives across territory	ignition risk	13. Grid design for resiliency and minimizing PSPS	14. Risk-based grid hardening and cost efficiency	15. Grid design and asset innovation	
	Start: 4 Current: 4 End:	Start: 3 Current: 3 End: 3	Start: 0 Current: 0 End: 0	Start: 3 Current: 3 End: 3	Start: 1 Current: 1 End: 2	
inspections	16. Asset inventory and condition assessments	17. Asset inspection cycle	18. Asset inspection effectiveness	19. Asset maintenance and repair	20. QA/QC for asset management	
	Start: 0 Current: 0 End:	D Start: 1 Current: 1 End: 1	Start: 1 Current: 1 End: 1	Start: 2 Current: 2 End: 2	Start: 2 Current: 2 End: 2	
and inspections	21. Vegetation inventory and condition assessments	22. Vegetation inspection cycle	23. Vegetation inspection effectiveness	24. Vegetation grow-in mitigation	25. Vegetation fall-in mitigation	26. QA/QC for vegetation management
	Start: 0 Current: 0 End:	D Start: 1 Current: 1 End: 1	Start: 1 Current: 1 End: 1	Start: 0 Current: 0 End: 0	Start: 0 Current: 0 End: 0	Start: 0 Current: 0 End: 0
	27. Protective equipment an device settings	d 28. Incorporating ignition risk factors in grid control	29. PSPS op. model and consequence mitigation	30. Protocols for PSPS initiation	31. Protocols for PSPS re- energization	32. Ignition prevention and suppression
	Start: 0 Current: 0 End:	D Start: 1 Current: 1 End: 1	Start: 1 Current: 1 End: 1	Start: 1 Current: 1 End: 1	Start: 4 Current: 4 End: 4	Start: 0 Current: 0 End: 3
G. Data governance	33. Data collection and curation	34. Data transparency and analytics	35. Near-miss tracking	36. Data sharing with research community		
	Start: 0 Current: 0 End:	2 Start: 0 Current: 0 End: 1	Start: 1 Current: 1 End: 1	Start: 1 Current: 1 End: 1		
methodology	37. Scenario analysis across different risk levels	38. Presentation of relative risk spend efficiency for portfolio of initiatives	39. Process for determining risk spend efficiency of vegetation management initiatives	40. Process for determining risk spend efficiency of system hardening initiatives	41. Portfolio-wide initiative allocation methodology	42. Portfolio-wide innovation in new wildfire initiatives
	Start: 0 Current: 0 End:	O Start: 0 Current: 0 End: 0	Start: 0 Current: 0 End: 0	Start: 0 Current: 0 End: 0	Start: 0 Current: 0 End: 0	Start: 0 Current: 0 End: 0
I. Emergency planning and preparedness	43. Wildfire plan integrated with overall disaster/ emergency plan	44. Plan to restore service after wildfire related outage	45. Emergency community engagement during and after wildfire	46. Protocols in place to learn from wildfire events	47. Processes for continuous improvement after wildfire and PSPS	1
		3 Start: 3 Current: 3 End: 3	Start: 1 Current: 1 End: 1	Start: 2 Current: 2 End: 4	Start: 0 Current: 0 End: 0	
J. Stakeholder cooperation and community engagement	48. Cooperation and best practice sharing with other utilities	49. Engagement with communities on utility wildfire mitigation initiatives	50. Engagement with LEP and AFN populations	51. Collaboration with emergency response agencies	52. Collaboration on wildfire mitigation planning with stakeholders	1
	Start: 0 Current: 0 End:	Start: 0 Current: 0 End: 3	Start: 0 Current: 0 End: 0	Start: 2 Current: 2 End: 2	Start: 0 Current: 0 End: 0	