

# NEEDLES PUBLIC UTILITY AUTHORITY WILDFIRE MITIGATION PLAN



VERSION 1.0

OCTOBER 3, 2019

# TABLE OF CONTENTS

|      |   |    |
|------|---|----|
| I.   | Overview .....  | 1  |
| A.   | Policy Statement .....  | 1  |
| B.   | Purpose of the Wildfire Mitigation Plan.....  | 1  |
| II.  | Objectives of the Wildfire Mitigation Plan.....   | 2  |
| A.   | Minimizing Sources of Ignition.....   | 2  |
| B.   | Resiliency of the Electric Grid .....   | 2  |
| C.   | Identifying Unnecessary or Ineffective Actions.....   | 2  |
| III. | Roles and Responsibilities .....  | 2  |
| A.   | Utility Governance Structure .....  | 2  |
| B.   | WILDFIRE PREVENTION .....   | 4  |
| C.   | WILDFIRE RESPONSE AND RECOVERY .....  | 5  |
| D.   | Coordination with Water Utilities/Department.....   | 5  |
| E.   | Coordination With Communication Infrastructure Providers .....                                      | 5  |
| F.   | Standardized Emergency Management System .....  | 6  |
| IV.  | Wildfire Risks and Drivers associated with design, construction, operation, and maintenance .....   | 6  |
| A.   | Particular Risks and Risk Drivers Associated With Topographic and Climatological Risk Factors ..... | 6  |
| B.   | Enterprisewide Safety Risks.....  | 7  |
| C.   | CPUC Fire Threat MaP .....  | 8  |
| D.   | High fire threat district .....   | 8  |
| E.   | Weather Monitoring .....  | 9  |
| F.   | design and Construction Standards .....   | 9  |
| G.   | Vegetation Management .....   | 9  |
| H.   | Inspections .....   | 11 |
| I.   | Workforce training .....  | 11 |

|  |    |
|--|----|
| J. Reclosing Policy .....                                      | 11 |
| K. Deenergization.....   | 11 |
| 1. Impacts to public safety .....                              | 12 |
| 2. Customer Notification Protocols.....                        | 12 |
| V. Community Outreach and Public Awareness.....                | 12 |
| VI. Restoration of Service .....                               | 13 |
| 11. Evaluating of the Plan.....                                | 13 |
| A. Metrics and Assumptions for Measuring Plan Performance..... | 13 |
| Metric 1: Fire Ignitions.....                                  | 13 |
| Metric 2: Wires Down.....                                      | 14 |
| B. Impact of Metrics on Plan .....                             | 14 |
| C. Monitoring and Auditing the Plan .....                      | 14 |
| D. Identifying and correcting Deficiencies in the Plan .....   | 14 |
| E. Monitoring the effectiveness of inspections.....            | 14 |
| Independent Auditor.....                                       | 14 |

## I. OVERVIEW

### A. POLICY STATEMENT

The Needles Public Utility Authority (NPUA) overarching goal is to provide safe, reliable, and economic electric service to its local community. In order to meet this goal, NPUA constructs, maintains, and operates its electrical lines and equipment in a manner that minimizes the risk of catastrophic wildfire posed by its electrical lines and equipment.

### B. PURPOSE OF THE WILDFIRE MITIGATION PLAN

This Wildfire Mitigation Plan describes the range of activities that the NPUA is taking to mitigate the threat of power-line ignited wildfires, including its various programs, policies, and procedures. This plan is subject to direct supervision by the Board of Public Utilities and the Needles Public Utility Authority and is implemented by the NPUA's Electric Supervisor. This plan complies with the requirements of Public Utilities Code section 8387 for publicly owned electric utilities to prepare a wildfire mitigation plan by January 1, 2020, and annually thereafter.

The NPUA is a department within the City of Needles. The NPUA Fire Prevention plan is focused on addressing and minimizing potential wildfire-related risks to public health, safety and welfare. The Fire Prevention plan reflects a broad range of activities performed not only by the electric department but through the City of Needles organization. The NPUA's Fire Prevention plan begins with operation, maintenance, inspection, and repair activities aimed at significantly reducing the potential for NPUA's electric facilities to become a source of ignition for a fire. The electric department continues to;

- Clear transmission lines of all trees and vegetation;
- Perform regular inspections all distribution and transmission lines;
- Repair and replacement transformers that could potential cause a risk;
- Coordinate vegetation removal through the City of Needles Parks and Recreation Department if an area is determined outside of the electric easements.

Through performing inspections and maintenance, the information gathered will be used to help fire agencies, and other fire-responders to determine the appropriate actions if a wildfire occurs by understanding the surround area.

The NPUA continues to monitor all fires within and surrounding its service territory both inside California and outside in Arizona and Nevada.

This Wildfire Mitigation Plan included the following elements:

- Objectives of the plan;
- Roles and responsibilities for carrying out the plan;
- Identification of key wildfire risks and risk drivers;
- Description of wildfire prevention, mitigation, and response strategies and programs;
- Community outreach and education;
- Metrics for evaluating the performance of the plan and identifying areas for improvement;
- Review and validation of the plan; and
- Timelines.

## II. OBJECTIVES OF THE WILDFIRE MITIGATION PLAN

### A. MINIMIZING SOURCES OF IGNITION

The primary goal of this Wildfire Mitigation Plan is to minimize the probability that NPUA's transmission and distribution system may be the origin or contributing source for the ignition of a fire. The NPUA has evaluated the prudent and cost-effective improvements to its physical assets, operations, and training that can help to meet this objective. The NPUA has implemented those changes consistent with this evaluation.

### B. RESILIENCY OF THE ELECTRIC GRID


The secondary goal of this Wildfire Mitigation Plan is to improve the resiliency of the electric grid. As part of the development of this plan, NPUA assesses new industry practices and technologies that will reduce the likelihood of an interruption (frequency) in service and improve the restoration (duration) of service.

### C. IDENTIFYING UNNECESSARY OR INEFFECTIVE ACTIONS

The final goal for this Wildfire Mitigation Plan is to measure the effectiveness of specific wildfire mitigation strategies. Where a particular action, program component, or protocol is determined to be unnecessary or ineffective, the NPUA will assess whether a modification or replacement is merited. This plan will also help determine if more cost-effective measures would produce the same or improved results.

## III. ROLES AND RESPONSIBILITIES

### A. UTILITY GOVERNANCE STRUCTURE

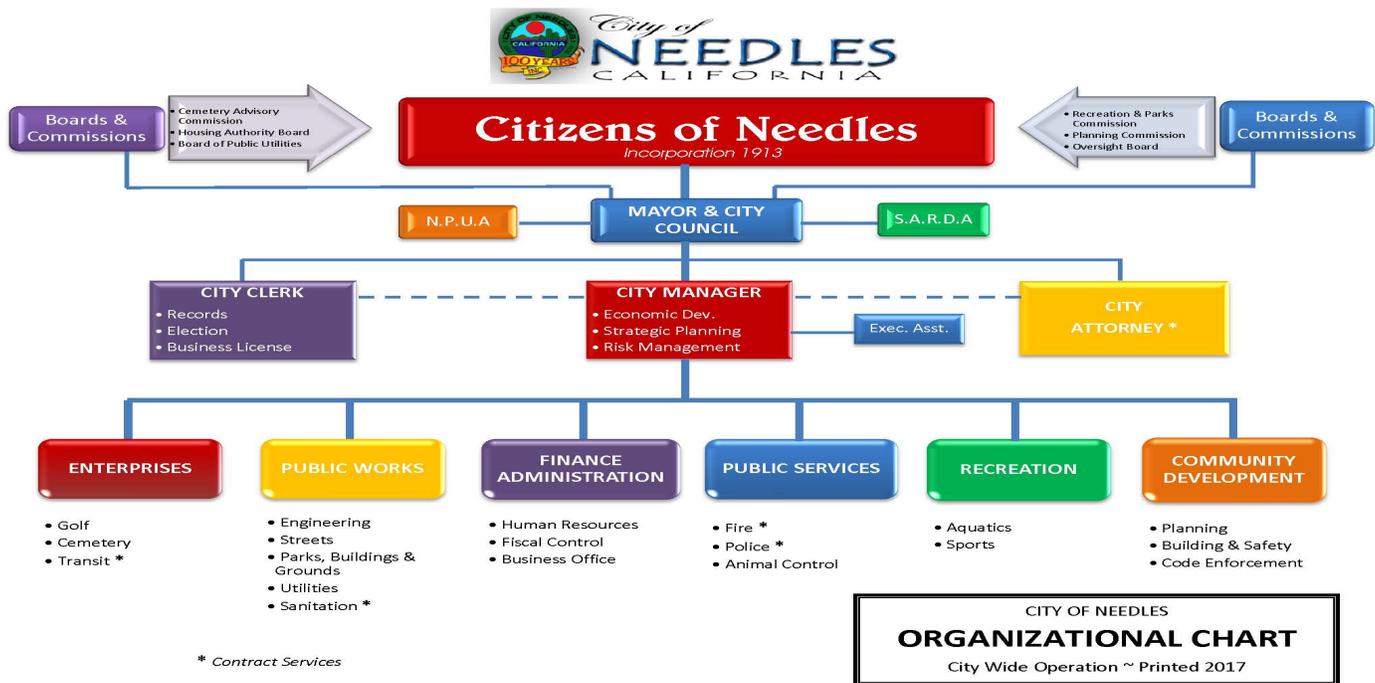

The City of Needles (Needles) is a charter city of the State of California located on the eastern border of California. Through the Needles Public Utilities Authority (NPUA), a component unit of the City, the City owns the Public Utilities Department. The Department consists of three Divisions Electric, Water, and Wastewater.

The electric distribution system serving the City was originally owned by the Needles Gas and Electric Company. The Needles Gas and Electric Company was purchased by the predecessor to CP National in 1930. On January 10, 1983, the City purchased the electric distribution system from CP National. However, pursuant to a management agreement, CP National continued to operate the system until July 1990. The City has operated the electric distribution system since that time.


The City's primary interest in purchasing the electric distribution system from CP National stemmed from a change in Federal law in 1982, relating to the sale of hydroelectricity power from federal projects. Under the revised regulations, inexpensive federal hydroelectricity power

from the U.S. Bureau of Reclamation's Parker-Davis Project (Hoover Dam), located on the Colorado River, became available to municipally owned utilities. The City's electorate authorized the issuance of revenue bonds to finance the acquisition of the electric distribution system from CP National.

The City provides electric service to the City and contiguous areas from the Nevada state line, south of Laughlin, Nevada, to the vicinity of Topock, Arizona.

The City has entered into a contract (Contract No. 87-BCA-10098) with the United States Department of Energy Western Area Power Administration ("WAPA") to purchase Federal hydroelectricity from the Parker-Davis generating facility. The contract with WAPA expires in 2019. Approximately 55% of the City's current electric energy is purchased from WAPA. Needles' peak electric demand is 22.41 MW, set in August, 2018 and services approximately 3,000 customers.

## B. WILDFIRE PREVENTION

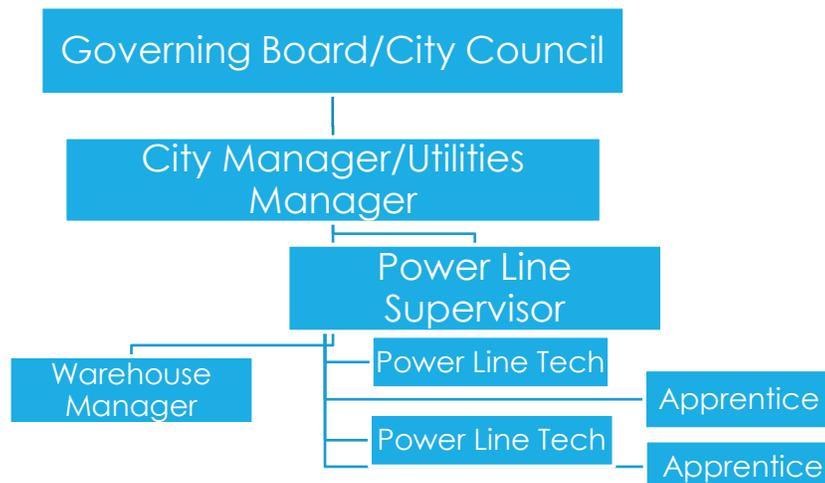

The electric department is under direct supervision from the City Manager/Utilities Manager, there is one Power Line Supervisor, two power line techs, two Apprentice Lineman and one Warehouse Manager. The electric department is responsible to;

- Operate system in a manner that will minimize potential wildfire risks.
- Take all reasonable and practicable actions to minimize the risk of a catastrophic wildfire caused by [POU] electric facilities.
- Coordinate with federal, state, and local fire management personnel as necessary or appropriate to implement [POU's] Wildfire Mitigation Plan.
- Immediately report fires, pursuant to existing POU practices and the requirements of this Wildfire Mitigation Plan.

- Take corrective action when the staff witnesses or is notified that fire protection measures have not been properly installed or maintained.
- Comply with relevant federal, state, and industry standard requirements, including the industry standards established by the California Public Utilities Commission.
- Collect and maintain wildfire data necessary for the implementation of this Wildfire Mitigation Plan.
- Provide regular training programs for all employees having obligations for implementation of this Wildfire Mitigation Plan.

## C. WILDFIRE RESPONSE AND RECOVERY

The City's communication strategy is structured so that all stakeholders receive accurate, timely and consistent information, with the overall message of safety first, for the public, employees and contractors.

When an emergency occurs, the electric departments supervisor will be responsible for communicating with the City Manager/Utilities Manager, customers, employees and contractors to set expectation and address emergency issues. This information will be provided through various communication channels such as company phone(s) and radios.

If business operations or households are disrupted, customers expect to know how long they will be impacted. Thus, estimated restoration times will be developed, monitored, adjusted and communicated to all stakeholders as the information becomes available.

## D. COORDINATION WITH WATER UTILITIES/DEPARTMENT

During declared emergencies, the electric department is responsible for coordinating efforts and sharing information with neighboring utilities relative to the out of service and damaged critical infrastructure.

During an event, the electric department will perform the following functions;

- Share information and prioritize restoration efforts relative to utility critical infrastructure that is out of service.
- Notify the water department of the downed communication wires.

## E. COORDINATION WITH COMMUNICATION INFRASTRUCTURE PROVIDERS

During declared emergencies, the electric department is responsible for coordinating efforts and sharing information with neighboring telecommunications utilities relative to the out of service and damaged critical infrastructure.

During an event, the electric department will perform the following functions;

- Share information and prioritize restoration efforts relative to utility critical infrastructure that is out of service.
- Coordinate with the appropriate telephone and cable company to set poles; and
- Notify the telephone and cable companies of downed communication wires.

## F. STANDARDIZED EMERGENCY MANAGEMENT SYSTEM

As a local governmental agency,<sup>1</sup> NPUA has planning, communication, and coordination obligations pursuant to the California Office of Emergency Services' Standardized Emergency Management System ("SEMS") Regulations,<sup>2</sup> adopted in accordance with Government Code section 8607. The SEMS Regulations specify roles, responsibilities, and structures of communications at five different levels: field response, local government, operational area, regional, and state.<sup>3</sup> Pursuant to this structure, NPUA annually coordinates and communicates with the relevant safety agencies as well as other relevant local and state agencies.

Under the SEMS structure, a significant amount of preparation is done through advanced planning at the county level, including the coordination of effort of public, private, and nonprofit organizations.

NPUA is a member of the California Utility Emergency Association, which plays a key role in ensuring communications between utilities during emergencies.

## IV. WILDFIRE RISKS AND DRIVERS ASSOCIATED WITH DESIGN, CONSTRUCTION, OPERATION, AND MAINTENANCE

### A. PARTICULAR RISKS AND RISK DRIVERS ASSOCIATED WITH TOPOGRAPHIC AND CLIMATOLOGICAL RISK FACTORS

<sup>1</sup> As defined in Cal. Gov. Code § 8680.2.

<sup>2</sup> 19 CCR § 2407.

<sup>3</sup> Cal. Gov. Code § 2403(b):

(1) "Field response level" commands emergency response personnel and resources to carry out tactical decisions and activities in direct response to an incident or threat.

(2) "Local government level" manages and coordinates the overall emergency response and recovery activities within their jurisdiction.

(3) "Operational area level" manages and/or coordinates information, resources, and priorities among local governments within the operational area and serves as the coordination and communication link between the local government level and the regional level.

(4) "Regional level" manages and coordinates information and resources among operational areas within the mutual aid region designated pursuant to Government Code §8600 and between the operational areas and the state level. This level along with the state level coordinates overall state agency support for emergency response activities.

(5) "State level" manages state resources in response to the emergency needs of the other levels, manages and coordinates mutual aid among the mutual aid regions and between the regional level and state level, and serves as the coordination and communication link with the federal disaster response system.

Within NPUA's service territory and the surrounding areas, the primary risk drivers for wildfire are the following:

- Extended drought;
- Vegetation type;
- Weather;
- High winds;
- Changing Weather Patterns (Climate Change)

## B. ENTERPRISEWIDE SAFETY RISKS

Western Area Power Administration (WAPA) delivers energy to the City of Needles on a 69KVA transmission line. The distribution line crosses the river in town at 3240 Needles Hwy, the firehouse switchyard. The City of Needles also has a back 69KVA Line that comes from the Nora McDowell Substation located 15 miles north of Needles.

Electric energy is delivered to the City at two substations. Needles #1 Substation has two banks located on Eagle Pass Road in the downtown area of the City. Bank #1 has a base rating of 7.5MVA and a 65 foot rise and force air rating of 9.3MVA.


The second substation, Bush Street Substation, has a base rating of 10MVA and a 65 foot rise with a forced air rating of 12MVA. The Bush Substation serves the west end of town.

The existing substations can handle current peak load requirements of 15,200 kilowatts. From the substations approximately 86 miles of distribution circuits deliver power at 12,000 volts to distribution transformers where the power is reduced to the voltages required by the individual customer's needs. The City electric department provides single phase, 60 Hertz, at one standard voltage (120/240 or 120/208 as may be selected by customers subject to availability at the premises).

While the NPUA makes improvements to the system annually, the main focus for the utility is ground clearance.

### C. CPUC FIRE THREAT MAP

The NPUA is not located within the CPUC Fire Threat Map and therefore is not located within an elevated hazard for the ignition of potential wildfires.

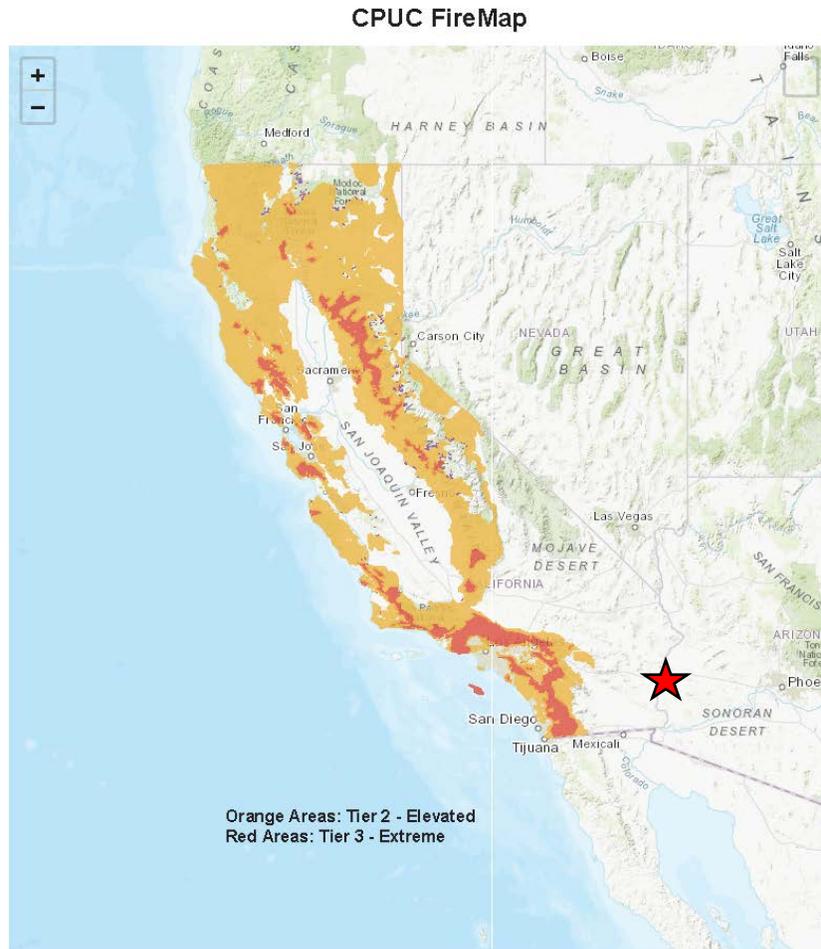

### D. HIGH FIRE THREAT DISTRICT

NPUA directly participated in the development of the California Public Utilities Commission's (CPUC) Fire-Threat Map,<sup>4</sup> which designates a High-Fire Threat District. In the map development

<sup>4</sup> Adopted by CPUC Decision 17-12-024.

process, NPUA served as a territory lead, and worked with utility staff and local fire & government officials to identify the areas of NPUA's service territory that are at an elevated or extreme risk of power line ignited wildfire. NPUA has incorporated the High Fire Threat District into its construction, inspection, maintenance, repair, and clearance practices, where applicable.

## E. WEATHER MONITORING

NPUA monitors current and forecasted weather data from a variety of sources including:

- United States National Weather Service
- United States Forest Service Wildland Fire Assessment System
- National Fire Danger Rating System
- National Interagency Fire Center – Predictive Services for Northern and Southern California.

NPUA assigns one of four operating conditions based on the relevant weather data and knowledge of local conditions:

- (1) Normal:** During normal conditions, no changes are made to operations or work policy.
- (2) Elevated:** During elevated fire-risk conditions; it must be determined by the Fire Coordinator and/or meteorologist that the burn environment has become conducive for wildfires within the NPUA service territory.
- (3) Extreme:** During extreme fire-risk conditions, it must be determined by the Fire Coordinator and/or meteorologist that due to the conditions of high winds, low relative humidity, and the burn environment will create critical fire weather conditions;
- (4) Red Flag:** If the National Weather Service declares a Red Flag Warning for any portion of the NPUA's Service.

## F. DESIGN AND CONSTRUCTION STANDARDS

NPUA's electric facilities are designed and constructed to meet or exceed the relevant federal, state, or industry standard. The NPUA treats CPUC General Order (GO) 95 as a key industry standard for design and construction standards for overhead electrical facilities. NPUA meets or exceeds all standards in GO 95. Additionally, NPUA monitors and follows as appropriate the National Electric Safety Code.

## G. VEGETATION MANAGEMENT

NPUA meets or exceeds the minimum industry standard vegetation management practices. For transmission-level facilities, NPUA complies with NERC FAC-003-4, where applicable. For both transmission and distribution level facilities, NPUA meets: (1) Public Resources Code section 4292; (2) Public Resources Code section 4293; (3) GO 95 Rule 35; and (4) the GO 95 Appendix E Guidelines to Rule 35. These standards require significantly increased clearances in the High Fire Threat District. The recommended time-of-trim guidelines do not establish a mandatory

standard, but instead provide useful guidance to utilities. NPUA will use specific knowledge of growing conditions and tree species to determine the appropriate time of trim clearance in each circumstance.

| GO 95, Rule 35, Table 1 |  |   |   |  |  |
|-------------------------|--|---|---|--|--|
| Case                    | Type of Clearance  | Trolley Contact, Feeder and Span Wires, 0-5kv | Supply Conductors and Supply Cables, 750 - 22,500 Volts | Supply Conductors and Supply Cables, 22.5 - 300 kV | Supply Conductors and Supply Cables, 300 - 550 kV (mm) |
| 13                      | Radial clearance of bare line conductors from tree branches or foliage               | 18 inches                                     | 18 inches   | ¼ Pin Spacing                                      | ½ Pin Spacing  |
| 14                      | Radial clearance of bare line conductors from vegetation in the Fire-Threat District | 18 inches                                     | 48 inches   | 48 inches  | 120 inches   |

| Appendix E<br>Guidelines to Rule 35   |         |         |
|---|---------|---------|
| <p>The radial clearances shown below are recommended minimum clearances that should be established, at time of trimming, between the vegetation and the energized conductors and associated live parts where practicable. Reasonable vegetation management practices may make it advantageous for the purposes of public safety or service reliability to obtain greater clearances than those listed below to ensure compliance until the next scheduled maintenance. Each utility may determine and apply additional appropriate clearances beyond clearances listed below, which take into consideration various factors, including: line operating voltage, length of span, line sag, planned maintenance cycles, location of vegetation within the span, species type, experience with particular species, vegetation growth rate and characteristics, vegetation management standards and best practices, local climate, elevation, fire risk, and vegetation trimming requirements that are applicable to State Responsibility Area lands pursuant to Public Resource Code Sections 4102 and 4293.</p> |         |         |
| Voltage of Lines  | Case 13 | Case 14 |
| Radial clearances for any conductor of a line operating at 2,400 or more volts, but less than 72,000 volts  | 4 feet  | 12 feet |
| Radial clearances for any conductor of a line operating at 72,000 or more volts, but less than 110,000 volts  | 6 feet  | 20 feet |
| Radial clearances for any conductor of a line operating at 110,000 or more volts, but less than 300,000 volts   | 10 feet | 30 feet |

|  |         |         |
|--|---------|---------|
| Radial clearances for any conductor of a line operating at 300,000 or more volts | 15 feet | 30 feet |
|--|---------|---------|

Within the High Fire Threat District, [POU] performs an evaluation of every tree that has the potential to strike overhead facilities if it were to fail on a [state frequency] basis. [POU] performs more frequent and detailed inspections of any such trees, and in cases where “hazard trees” (Dead, Dying, Diseased or leaning) could strike the facilities, will work with the land owner to remove the tree or portion of the tree that poses a risk.

## H. INSPECTIONS

The NPUA meets or exceeds the minimum inspection requirements provided in CPUC GO 165 and CPUC GO 95, Rule 18. Pursuant to these rules, NPUA inspects electric facilities in the High Fire Threat District more frequently than the other areas of its service territory. Additionally, NPUA staff uses their knowledge of the specific environmental and geographical conditions to determine when areas outside of the High Fire Threat District require more frequent inspections.

If NPUA staff discovers a facility in need of repair that is owned by an entity other than NPUA, NPUA will issue a notice to repair to the facility owner and work to ensure that necessary repairs are completed promptly.

NPUA works to ensure that all inspections to be performed within the High Fire Threat District are completed before the beginning of the historic fire season, [typically September 1]. NPUA monitors drought conditions and other relevant factors throughout the year to determine if inspections should be completed on a shorter timeframe.

## I. WORKFORCE TRAINING

NPUA has implemented work rules and complementary training programs for its workforce to help reduce the likelihood of the ignition of wildfires. The NPUA inspects power lines and other electrical equipment during potential risk times.

## J. RECLOSING POLICY

The NPUA does not have SCADA controlled reclosers, two qualified linemen reclose or close the distribution system. Lockout, tagout safety procedures are followed.

## K. DEENERGIZATION

The NPUA has the authority to preemptively shut off power due to fire-threat conditions; however, this option will only be used in extraordinary circumstances. The NPUA will make a case-by-case decision to shut off power based on the following considerations:

- Red Flag Warnings issued by the National Weather Service for fire weather zones that contain [POU] circuits;
- NPUA staff assessments of local conditions, including wind speed (sustained and gust), humidity and temperature, fuel moisture, fuel loading and data from weather stations;

- Real-time information from staff located in areas identified as at risk of being subject to extreme weather conditions;
- Input from San Bernardino County fire experts and vegetation experts;
- Input from local and state fire authorities regarding the potential consequences of wildfires in select locations;
- Alternative ways to reroute power to affected areas;
- Awareness of mandatory or voluntary evacuation orders in place;
- Expected impact of de-energizing circuits on essential services;
- Other operational considerations to minimize potential wildfire ignitions, including the blocking of reclosers on the identified circuit(s);
- On-going fire activity throughout NPUA's territory and California;
- Ability to notify customers;
- Notifications to local governments and public officials; and
- Potential impacts to communities and customers

---

## 1. IMPACTS TO PUBLIC SAFETY

The following is a listing off facilities which are special considerations of the public safety during a power outage;

- Hospitals and Emergency Medical Facilities;
- Emergency Shelters and Cooling Centers;
- Fire, Police, Paramedics and Rescue Facilities;
- Emergency Management Offices
- Water and Wastewater Facilities;
- Critical Utility and Communication Facilities;
- Mass Transit (BNSF, Airport;)
- Critical Flood Control Structures;
- Fort Mojave Indian Tribe Hazardous Mitigation Facility

In the event of a wildfire and potential outages those accounts, the Priority Restoration Group will be notified of a potential impact first.

---

## 2. CUSTOMER NOTIFICATION PROTOCOLS

The NPUA takes priority in providing notification to all customers who are affected by a power outage. The NPUA will establish a dispatch center at City Hall offices to provide real time information to the customers such as;

- Effective area(s);
- Estimated restoration time

## V. COMMUNITY OUTREACH AND PUBLIC AWARENESS

When a wildfire is mobilized, the City Manager/Utilities Manager branches to provide public awareness through the following;

- Issuing a wildfire press release;
- Arranging media interviews and press conferences, as necessary;

## VI. RESTORATION OF SERVICE

Restoring power after a major storm or wildfire is a complex task that must be completed quickly and safely. A speedy restoration requires significant communication, along with skilled line workers. The process for restoration is;

1. The electric department establishes a command post at the nearest substation to the affected area
2. An inspection is conducted from the substation out to the affected area
3. Crews inspect the affected area and create a damage assessment
4. The restoration team ensures the line is deenergized and grounded
5. Replacement of damaged material such as conductors, transformers, insulators is the damaged area
6. The effected circuit is re-energized
7. Households in isolated are re-energized
8. Crews will remain at the command post for one-hour following the full restoration to ensure all circuits are on
9. Dispatch will call the crew is calls are reported for no power
10. Crews may be dispatched to individual homes to reset the breaker

## 11. EVALUATING OF THE PLAN

### A. METRICS AND ASSUMPTIONS FOR MEASURING PLAN PERFORMANCE

NPUA will track two metrics to measure the performance of this Wildfire Mitigation Plan: (1) number of fire ignitions; and (2) wires down within the service territory.

#### METRIC 1: FIRE IGNITIONS

For purposes of this metric, a fire ignition is defined as follows:

- NPUA facility was associated with the fire;
- The fire was self-propagating and of a material other than electrical and/or communication facilities;
- The resulting fire traveled greater than one linear meter from the ignition point; and
- NPUA has knowledge that the fire occurred.

In future Wildfire Mitigation Plans, NPUA will provide the number of fires that occurred that were less than 10 acres in size. Any fires greater than 10 acres will be individually described.

---

## METRIC 2: WIRES DOWN

The second metric is the number of distribution and transmission wires downed within NPUA's service territory. For purposes of this metric, a wires down event includes any instance where an electric transmission or primary distribution conductor falls to the ground or on to a foreign object. NPUA will divide the wires down metric between wires down inside and outside of the High Fire Threat District.

NPUA will not normalize this metric by excluding unusual events, such as severe storms. Instead, NPUA will supplement this metric with a qualitative description of any such unusual events.

### B. IMPACT OF METRICS ON PLAN

In the initial years, NPUA anticipates that there will be relatively limited data gathered through these metrics. However, as the data collection history becomes more robust, NPUA will be able to identify areas of its operations and service territory that are disproportionately impacted. NPUA will then evaluate potential improvements to the plan.

### C. MONITORING AND AUDITING THE PLAN

This Wildfire Mitigation Plan will be presented to the Board of Public Utilities (BPU), Needles Public Utilities Authority (NPUA) and the City Council. BPU will present this plan to Needles Public Utility Authority on an annual basis. Additionally, a qualified independent evaluator will present a report on this plan to the Needles Public Utility Authority (NPUA).

The NPUA will perform an annual audit which will review all parts of the Wildfire Mitigation Plan, as well as a review of both pending and completed maintenance work identified within the NPUA's service territory. As well as verifying overhead and underground facilities that were inspected in the previous year.

### D. IDENTIFYING AND CORRECTING DEFICIENCIES IN THE PLAN

Upon finding any deficiencies in performance against the plan or need for improvement in the Plan itself, the NPUA will be responsible for correcting the deficiencies.

### E. MONITORING THE EFFECTIVENESS OF INSPECTIONS

NPUA's third part verifier will review various aspects of the risk reduction measure of part of this Wildfire Mitigation Plan. Depending on the quality of performance and value received from the third-party entity, the process may be expanded further to additional potential risk reduction measures.

## INDEPENDENT AUDITOR

Public Utilities Code section 8387(c) requires the NPUA to contract with a qualified independent evaluator with experience in assessing the safe operation of electrical infrastructure to review

and assess the comprehensiveness of this Wildfire Mitigation Plan. The independent evaluator must issue a report that is posted to NPUA's website. This report must also be presented to BPU and NPUA at a public meeting.

(ACT) – ACTION NEEDED  
(INF) – INFORMATION ONLY  
(DIS) – DISCRETIONARY

BOARD OF PUBLIC UTILITIES OF THE CITY OF NEEDLES

TUESDAY, OCTOBER 1, 2019 - 4:00 P.M. – ADJOURNED REGULAR MEETING

CITY COUNCIL CHAMBERS - 1111 BAILEY AVENUE, NEEDLES

AGENDA

**Approval of Agenda** (ACT)

**Correspondence**

**Public Appearance:** Persons wishing to address the Board on subjects other than those scheduled are requested to do so at this time. When addressing the Board, please come to the podium and give your name and address for the record. In order to conduct a timely meeting, a three minute time limit per person has been established by Municipal Code Section 2-18. Amendments to California Government Code Sec. 54950 prohibits the Board from taking action on a specific item until it appears on the agenda.

**Consent Calendar:** All matters listed on the Consent Calendar are considered to be routine and will be enacted by one motion in the form listed. The Chairman or any Member of the Board may pull an item from the Consent Calendar for discussion. Prior to Board action, a member of the public may address the Board on matters scheduled on the Consent Calendar. A three-minute time limit per person applies.

**Recommended Action:** Approve Items 1 through 3 on the Consent Calendar by affirmative vote (ACT)

1. Minutes of adjourned regular meeting held August 13 and regular meeting held September 3, 2019
2. Authorize staff to publish a request for proposals to conduct a comprehensive electric, water and wastewater utility cost of service ratemaking study
3. Resolution No. 10-1-19 BPU adopting the Needles Public Utility Authority Wildfire Mitigation Plan dated October 3, 2019

**End of Consent**

**Regular Item** (three-minute time limit per person applies)

None

## Reports

(INF)

4. EUSI, LLC operational support services relating to the wastewater treatment facility and collection system August 2019

## Pending Matters (not for discussion at this time)

- a) Status of electric meter calibration program (meeting of April 2, 2019)

## Manager's Report

- a) Incident Report(s)

## Board Requests

## Adjournment

Posted: September 27, 2019

### **INTERNET ACCESS TO BOARD AGENDA AND STAFF REPORT MATERIAL IS AVAILABLE PRIOR TO THE MEETING AT**

<http://www.cityofneedles.com>

SB 343 - DOCUMENTS RELATED TO OPEN SESSION AGENDAS - Any public record, relating to an open session agenda item, that is distributed within 72 hours prior to a meeting is available for public inspection at the Needles Administrative Office, 817 Third Street, Needles, CA 92363.

In compliance with the Americans with Disabilities Act, if you need special assistance to participate in this meeting, please contact Cheryl Sallis, Secretary to the Board, at (760) 326-2113 ext 115.

Notification 48 hours prior to the meeting will enable the City to make reasonable arrangements to ensure accessibility to this meeting (28 CFR 35.102-104 ADA Title II)



## City of Needles, California Request for Board Action

---

CITY COUNCIL       NPUA       BOARD OF PUBLIC UTILITIES  
 Regular       Special

Meeting Date:      October 1, 2019

Title:      Senate Bill (SB) 901 Compliance: Adoption of the Needles Public Utility Authority Wildfire Mitigation Plan

**Background:**      In 2008, the California Public Utilities Commission (“CPUC”) initiated a proceeding to address fires related to utility infrastructure, following a series of wildfires that occurred in 2007 and 2008. The goal of this proceeding was to establish new industry standards that would reduce the risk of electric line-ignited wildfires, with a focus on areas of the state where wildfire risks are elevated. In 2012, the CPUC adopted three interim fire maps that designated areas of the state where stricter inspection and vegetation clearance requirements would apply to overhead utility poles and equipment.<sup>1</sup> These interim maps were based on generalized wildfire threat, rather than the areas that were at a unique risk of electric line-ignited fires. The CPUC acknowledged the need for a better map and, in the same 2012 Decision, the CPUC directed parties to develop a more precise statewide fire map that identified areas of the state at an elevated risk of electric line-ignited wildfires.<sup>2</sup>

In 2016, Governor Brown signed Senate Bill (“SB”) 1028 (stats. 2016), which required publicly owned utilities (“POUs”) to identify additional wildfire mitigation measures that the POU could take if the POU governing board first found that its overhead electric lines and equipment posed a significant risk of causing a catastrophic wildfire. SB 1028 required that the POU governing board must base this determination on “historical fires and local conditions,” and must consult with local fire departments and other entities with responsibilities for the control of wildfires within the relevant area.<sup>3</sup> These requirements were specified in the newly added Public Utilities Code Section 8387.

In 2018, the CPUC completed the development of the statewide Fire Threat Map that designates areas of the state at an elevated risk of electric line-ignited wildfires.<sup>4</sup> This updated map incorporated historical fire data, fire-behavior modeling, assessments of fuel, weather modeling, and host of other factors. The map development and approval process involved detailed review by the relevant utility staff and local fire officials, a peer review process, and ultimate approval by a team of technical experts led by the California Department of Forestry and Fire Protection (“CAL FIRE”). The CPUC’s Fire Threat Map includes three Tiers/Levels of fire threat risk. Tier 1 consists of areas that have the lowest hazards and risks. Tier 2 consists of areas where there is an elevated

---

<sup>1</sup> D.12-01-032.

<sup>2</sup> D.12-01-032 at 146-147.

<sup>3</sup> Cal. Pub. Util. Code § 8387(b).

<sup>4</sup> PG&E Advice Letter 5211-E/3172-E, “Joint Filing – Adoption of Final California Public Utilities Commission Fire-Threat Map,” Jan. 5, 2018, *available at*

[https://www.pge.com/tariffs/assets/pdf/adviceletter/ELEC\\_5211-E.pdf](https://www.pge.com/tariffs/assets/pdf/adviceletter/ELEC_5211-E.pdf); SED Disposition Letter Approving Advice Letter 5211-E/3172-E, January 19, 2018, *available at*

[https://www.pge.com/tariffs/assets/pdf/adviceletter/ELEC\\_5211-E.pdf](https://www.pge.com/tariffs/assets/pdf/adviceletter/ELEC_5211-E.pdf)



## City of Needles, California Request for Board Action

risk for destructive electric line-ignited wildfires. Finally, Tier 3 consists of areas where there is an extreme risk for destructive electric line-ignited wildfires.

NPUA Staff reviewed the CPUC's Fire Threat Map and determined that no NPUA overhead electric lines or equipment are located in an area designated as either Tier 2 (elevated risk) or Tier 3 (extreme risk). Staff also reviewed historical fire data and local conditions. Based on this review, staff concluded NPUA's overhead electric lines and equipment did not pose a significant wildfire risk.

In 2018, Governor Brown signed SB 901 (stats. 2018), which addressed a wide range of issues relating to wildfire prevention, response, and recovery. SB 901 substantially revised the Public Utilities Code Section 8387, eliminating the prior process established by SB 1028 and instead making it mandatory for all POU's (regardless of size or wildfire risk) to develop a wildfire mitigation plan. Pursuant to the amended Section 8387, all POU's must present a wildfire mitigation plan to its governing board prior to January 1, 2020, and annually thereafter. Section 8387(b)(2) specifies the topics that must be addressed in the POU wildfire mitigation plans, which includes: (a) the responsibilities of the persons tasked with executing the plan; (b) a description of the POU's wildfire mitigation preventative strategies and programs; (c) a description of the metrics the POU will use to evaluate the wildfire mitigation plan's performance and discussion of how those metrics informed the current wildfire mitigation plan; (d) protocols for disabling reclosers and deenergizing portions of the electrical system; and (e) identification, description, and prioritization of all wildfire risks within the POU's service territory.

SB 901 requires that POU's must present their wildfire mitigation plan at an appropriately noticed public meeting and receive public comment. The POU must also verify that the wildfire mitigation plan complies with all applicable rules, regulations, and standards. POU's must also have their plan reviewed by a qualified independent evaluator to assess the comprehensiveness of the plan. The independent evaluator must then issue a report that the POU must make available on the POU's website, and the POU must present the report at a public meeting of the POU's governing board.

In 2019, two new bills (SB 1054 and SB 111) made additional major reforms relating to wildfires. As part of these reforms, SB 111 created a new state agency called the California Wildfire Safety Advisory Board ("Board"). The Board will be made up of seven members, five appointed by the Governor, one appointed by the Speaker of the Assembly, and one appointed by the Senate Rules Committee. The members of the board must be selected from industry experts, academics, and people with labor and workforce safety experience. At least three members must be experienced in the safe operation, design, and engineering of electrical infrastructure. SB 1054 requires that all POU's must submit their wildfire mitigation plans to the Board by July 1 of each year, starting in 2020. The Board will then review the POU plans and will provide comments and advisory opinions on the content and sufficiency the plans.



## City of Needles, California Request for Board Action

Pursuant to Public Utilities Code, Section 8387, NPUA has prepared the required wildfire mitigation plan. Staff has reviewed the NPUA's wildfire mitigation plan and concluded that the plan meets all the required criteria as provided in Section 8387.

Following the adoption of the NPUA's Wildfire Mitigation Plan an audit of the plan is expected to be review with the San Bernardino County Fire Department. The plan and audit findings will be published at a public meeting and received public comment. The report and audit must be available on the NPUA's electric department website.

**Fiscal Impact:** None

**Recommended Action:** *Approve* Resolution No. 10-1-19 BPU adopting the annual Wildfire Mitigation Plan

**Submitted By:** Rainie Torrance, Senior Accountant

**City Management Review:** Rick

**Date:** 9/25/19

Approved:

Not Approved:

Tabled:

Other:

Agenda Item: \_\_\_\_\_

RESOLUTION NO. 10-1-19 BPU

A RESOLUTION OF THE BOARD OF PUBLIC UTILITIES OF THE  
CITY OF NEEDLES, CALIFORNIA, ADOPTING ANNUAL  
WILDFIRE MITIGATION PLAN

WHEREAS, the Board of Public Utilities is authorized under various provisions of the [California Constitution and the general laws of California (including, specifically, Article XI, Section 9(a) of the California Constitution, Public Utilities Code Section 10004, and Government Code section 39732(a))] to establish, purchase, and operate a public utility to furnish its inhabitants with, among other things, electricity; and

WHEREAS, the City of Needles operates a municipal electric utility; and

WHEREAS, the Needles Public Utility Authority is generally subject to the legislative and regulatory requirements applicable to local publicly owned electric utilities ("POUs"); and

WHEREAS, Senate Bill ("SB") 1028 (stats. 2016), adding California Public Utilities Code, Section 8387, requires each POU to construct, maintain, and operate its electrical lines and equipment in a manner that will minimize the risk of wildfire posed by those electrical lines and equipment; and

WHEREAS, SB 901 (stats. 2018), amending California Public Utilities Code Section 8387, requires all POUs to prepare a wildfire mitigation plan before January 1, 2020, and annually thereafter; and

WHEREAS, California Public Utilities Code Section 8387(b)(2) specifies the content that must be included in each POU's wildfire mitigation plan; and

WHEREAS, California Public Utilities Code Section 8387(c) requires each POU to have a qualified independent evaluator review its wildfire mitigation plan to assess the comprehensiveness of its plan and to issue a report that is made available on the POU's website and presented at a public meeting; and

WHEREAS, California Public Utilities Code Section 8387(b)(3) requires each POU to present its wildfire mitigation plan at an appropriately noticed public meeting and to verify that its plan complies with all applicable rules, regulations, and standards, as appropriate; and

WHEREAS, SB 111 (stats. 2019), adding California Public Utilities Code Section 326.1, established the California Wildfire Safety Advisory Board; and

WHEREAS, SB 1054 (stats. 2019), amending California Public Utilities Code Section 8387, requires each POU to submit its wildfire mitigation plan to the California Wildfire Safety Advisory Board by July 1 of each year, starting in the year 2020; and

WHEREAS, pursuant to California Public Utilities Code Section 326.2, the California Wildfire Safety Advisory Board will review each POU's wildfire mitigation plan and will provide comments and advisory opinions on the content and sufficiency of each plan; and

RESOLUTION NO. 10-1-19 BPU

(Page Two)

WHEREAS, Needles Public Utility Authority staff prepared a wildfire mitigation plan for calendar year 2020, addressing all statutory criteria; and

WHEREAS, Needles Public Utility Authority verified that the wildfire mitigation plan complies with all applicable rules, regulations, and standards; and

WHEREAS, a qualified independent evaluator and, after reviewing the Needles Public Utility Authority's wildfire mitigation plan will determined that the plan meets the requirements of California Public Utilities Code Section 8387; and

WHEREAS, Needles Public Utility Authority staff will submit its wildfire mitigation plan, adopted today by Board of Public Utilities' governing board, to the California Wildfire Safety Advisory Board before July 1, 2020.

NOW, THEREFORE, BE IT RESOLVED that the Board of Public Utilities, pursuant to California Public Utilities Code Section 8387, adopts the Needles Public Utility Authority Wildfire Mitigation Plan, dated October 3, 2019.

PASSED, APPROVED AND ADOPTED at a regular meeting of the Board of Public Utilities of the City of Needles, California, held on the 1st day of October, 2019 by the following vote:

AYES:

NOES:

ABSENT:

ABSTAIN:

ATTEST:

\_\_\_\_\_  
Chairman

\_\_\_\_\_  
Secretary

# City of Needles Wildfire Prevention Mitigation Plan **POTENTIAL AREAS OF IMPACT EXHIBIT**

